



AXIS A1810-B Network Door Controller

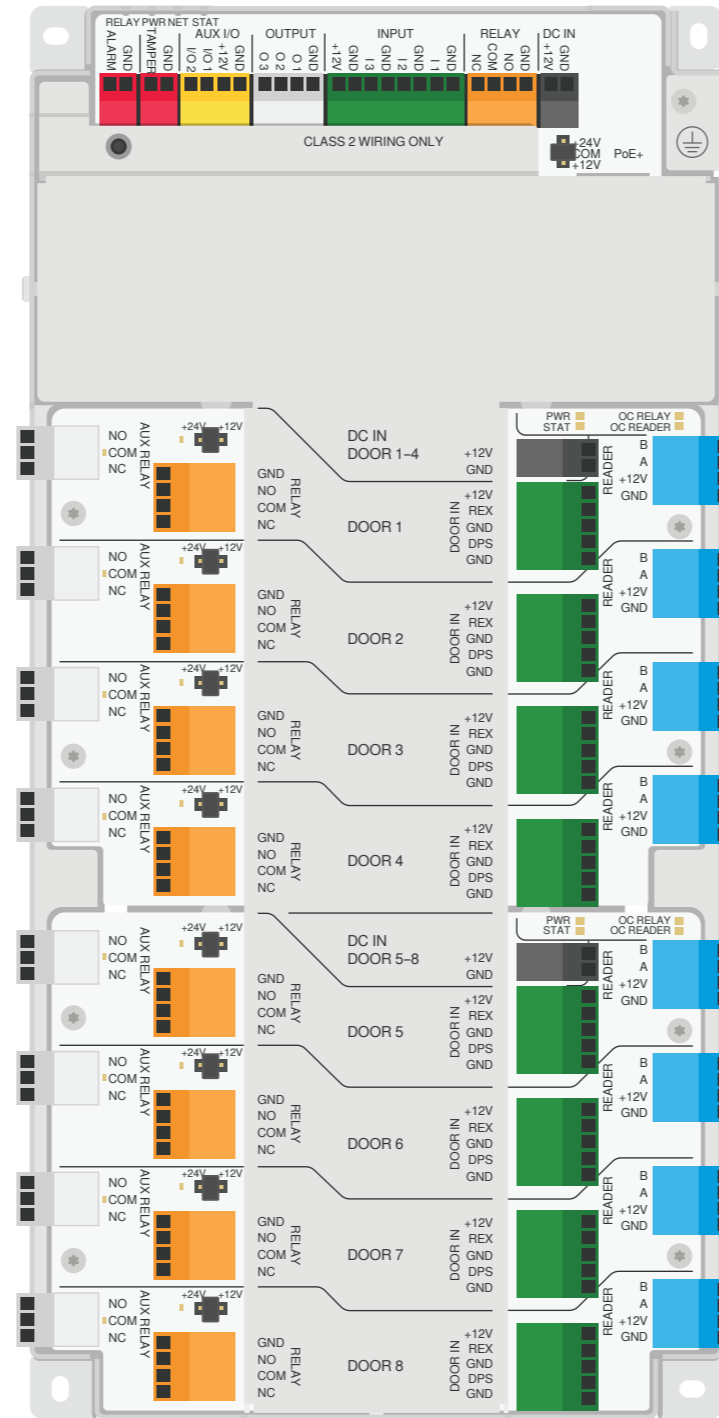

Electrical wiring drawings

Power supply – separate power supply

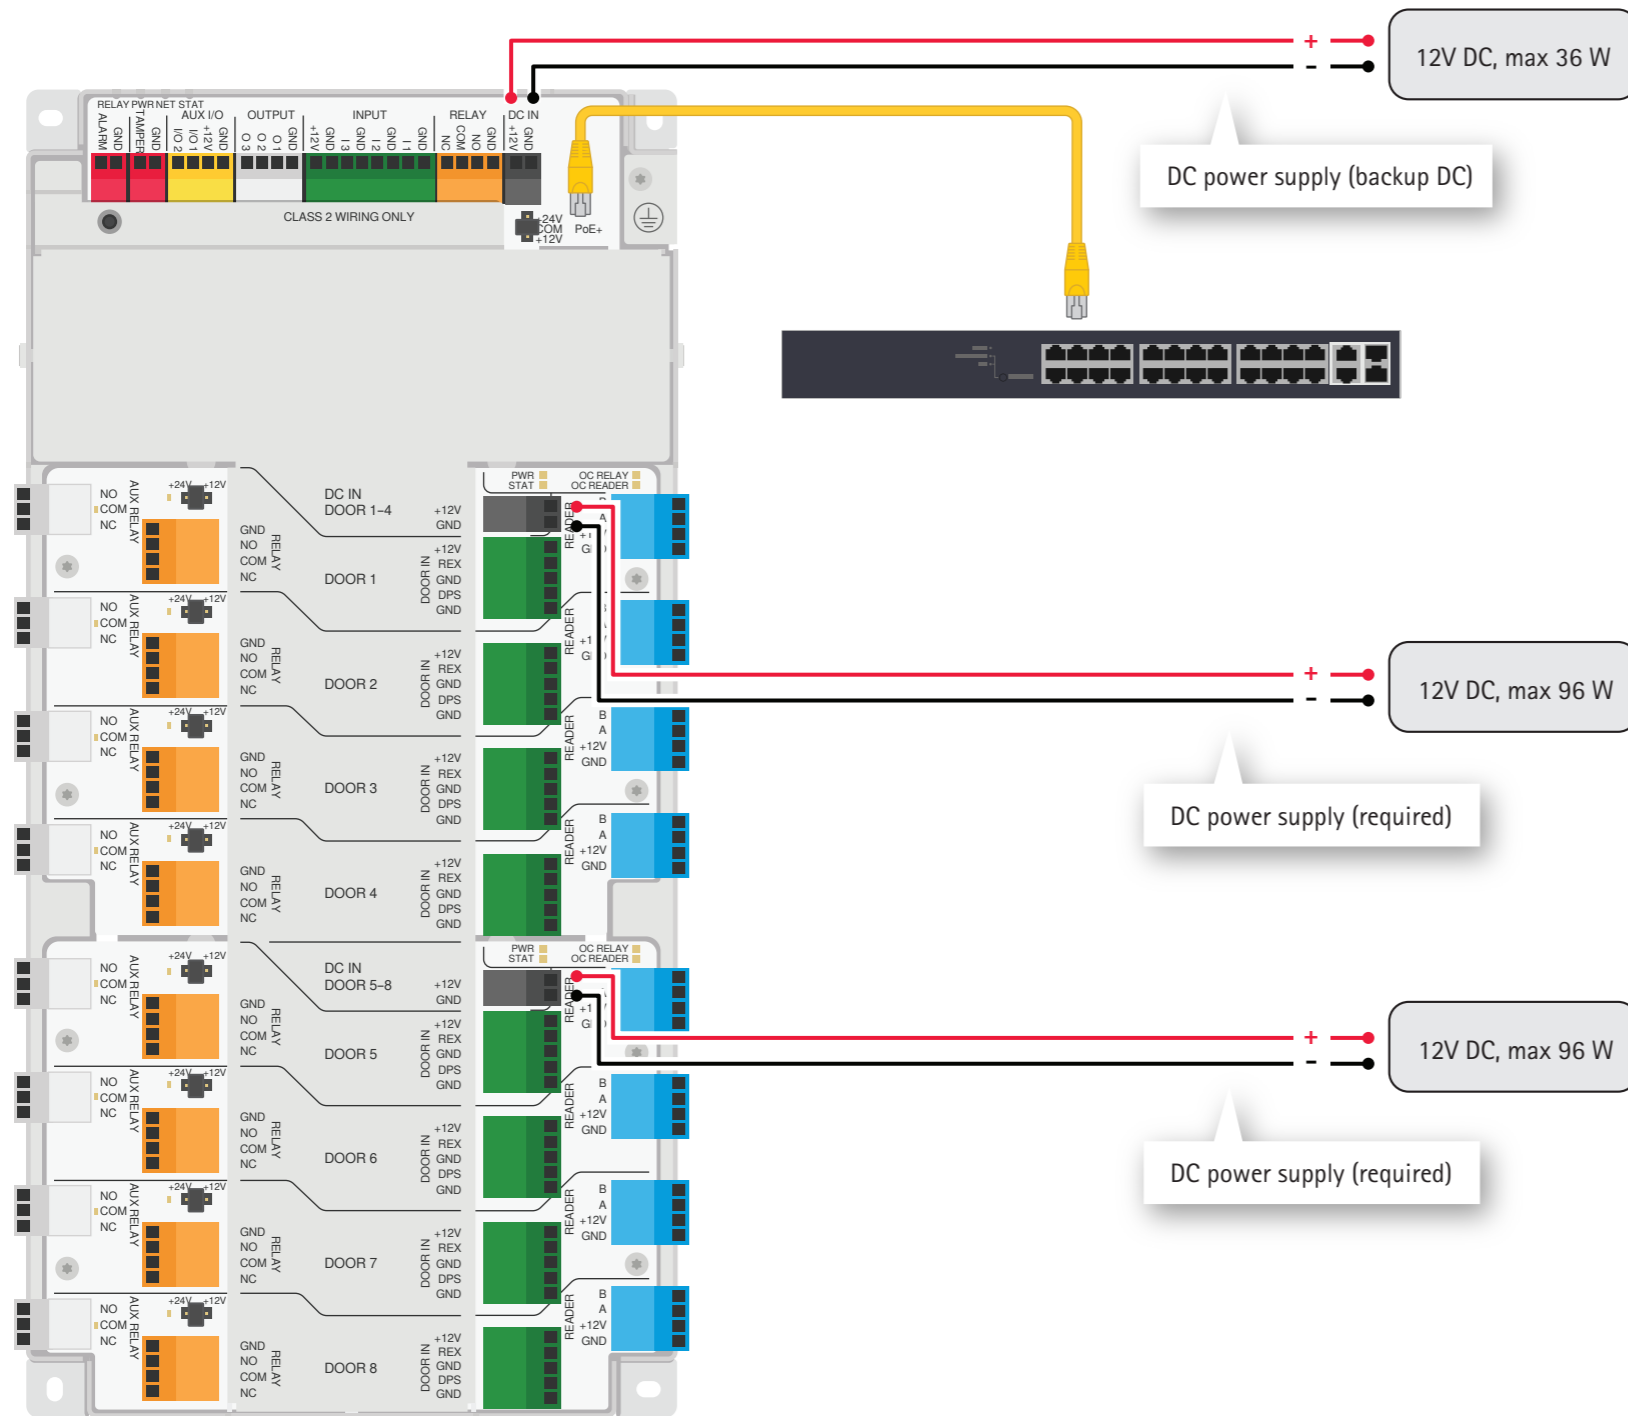

Application

Door 1-4 and Door 5-8 require separate power

Requirements

- > Class 2 power supply: Separate power
 - > Main: max 36 W
 - > Door 1-4: max 96 W*
 - > Door 5-8: max 96 W*
- *to fulfill the power budget for door peripherals
- > Wiring:
 - > DC AWG 16-14

Considerations

- > PoE Class 3 or PoE Class 4


Adhere to local life safety code in all installations.

Illustration does not depict readers, door monitors, REX devices, locks Power backups and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Power supply – single power supply

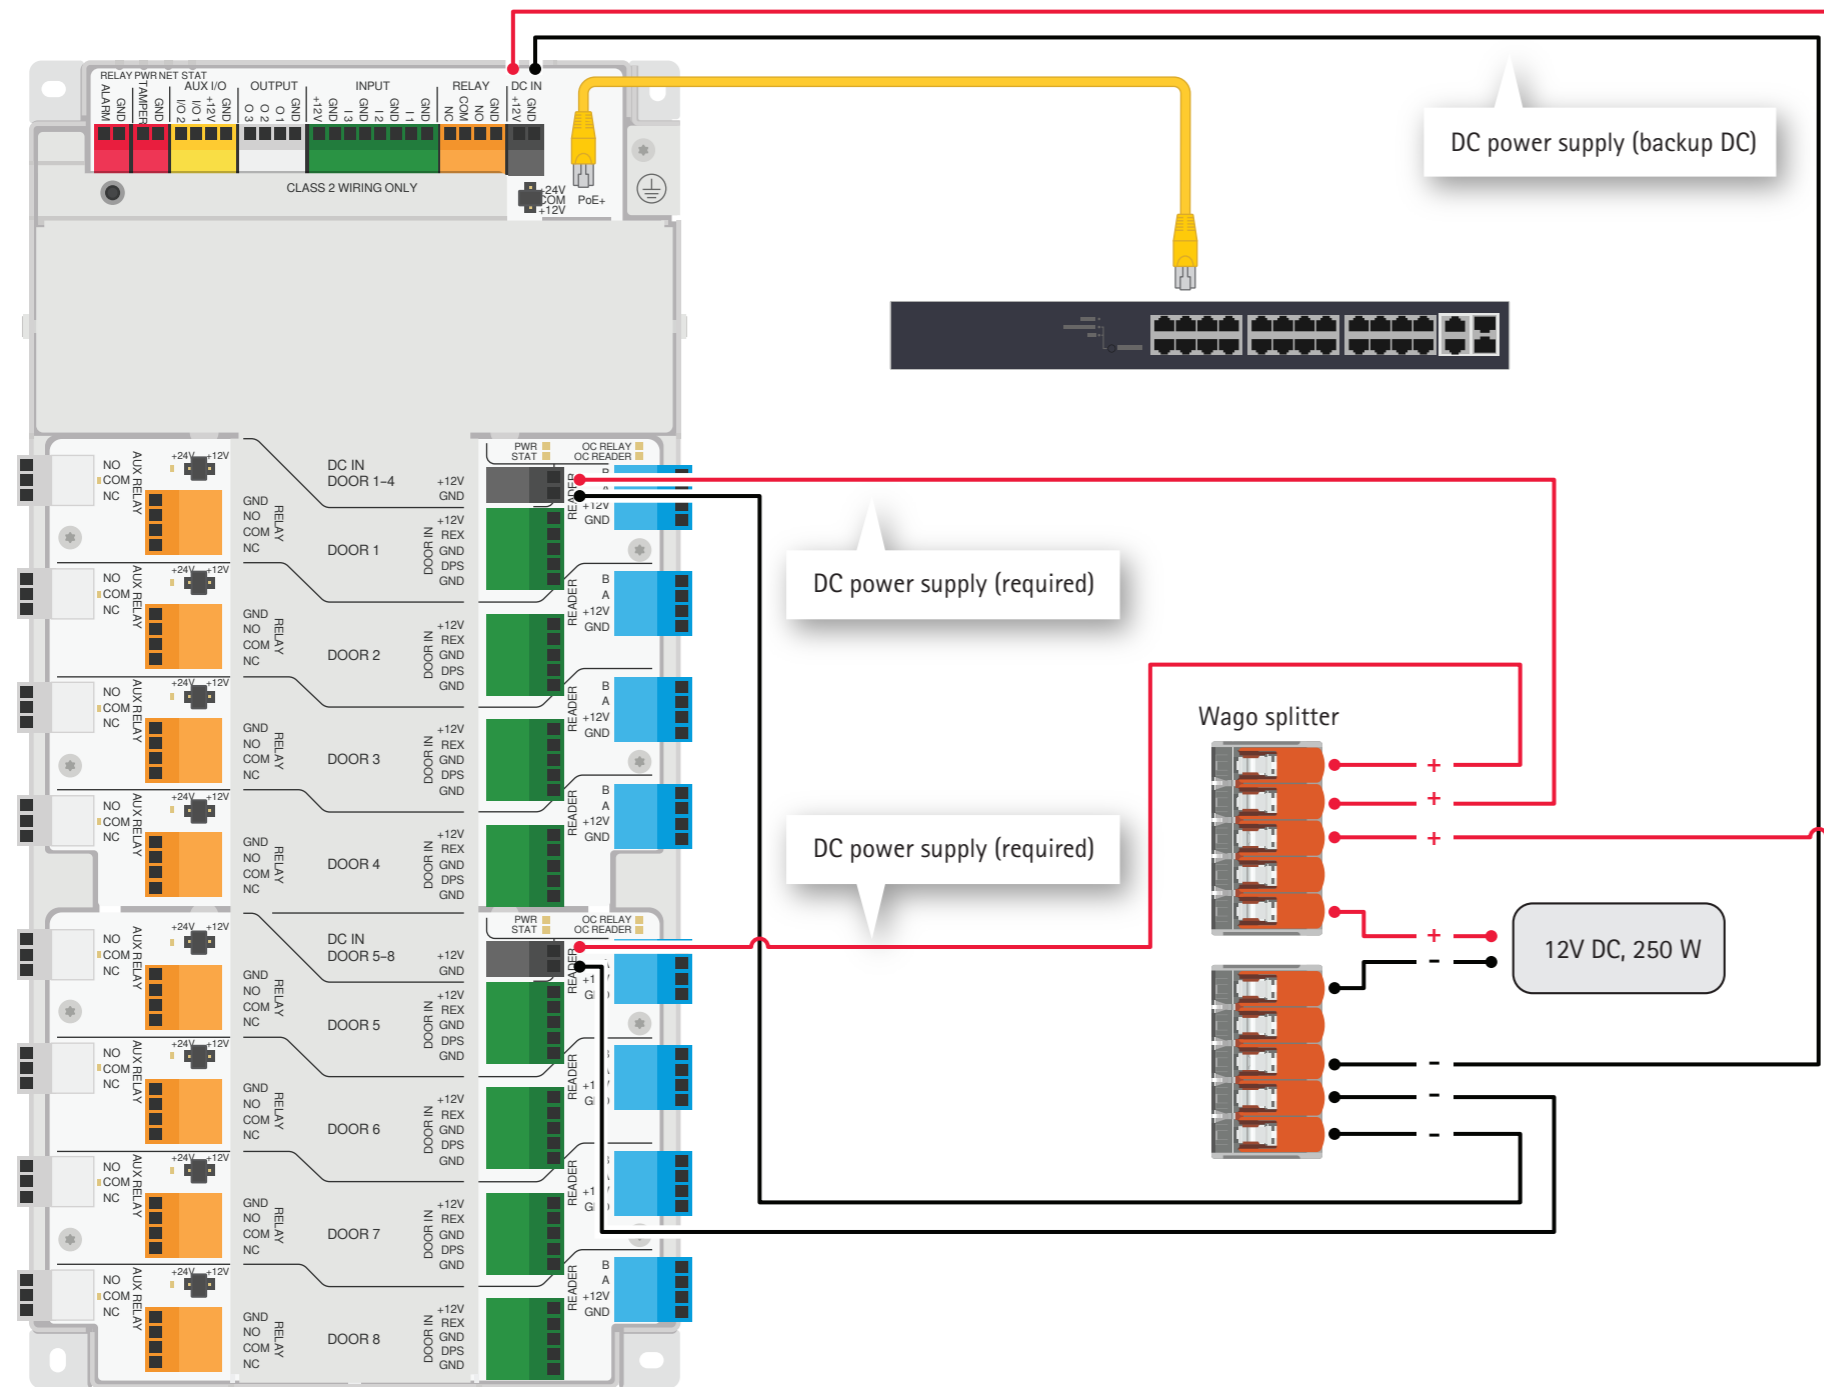

Application

Door 1-4 and Door 5-8 require separate power

Requirements

- > Class 3 power supply: Split the power using Wago splitters*
 - > Main/Door 1-4/Door 5-8: 250 W shared**

*included in the product box
 **to fulfill the power budget for door peripherals

- > Wiring:
 - > DC AWG 16-14

Considerations

- > PoE Class 3 or PoE Class 4

Adhere to local life safety code in all installations.

Illustration does not depict readers, door monitors, REX devices, locks Power backups and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.


This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Standard one door installation

Application
Standard one-door installation with configuration in AXIS Camera Station


Considerations

- > 12 V or 24 V fail-secure lock
- > PoE Class 3 or PoE Class 4
- > All peripheral consumption within the controller's power budget

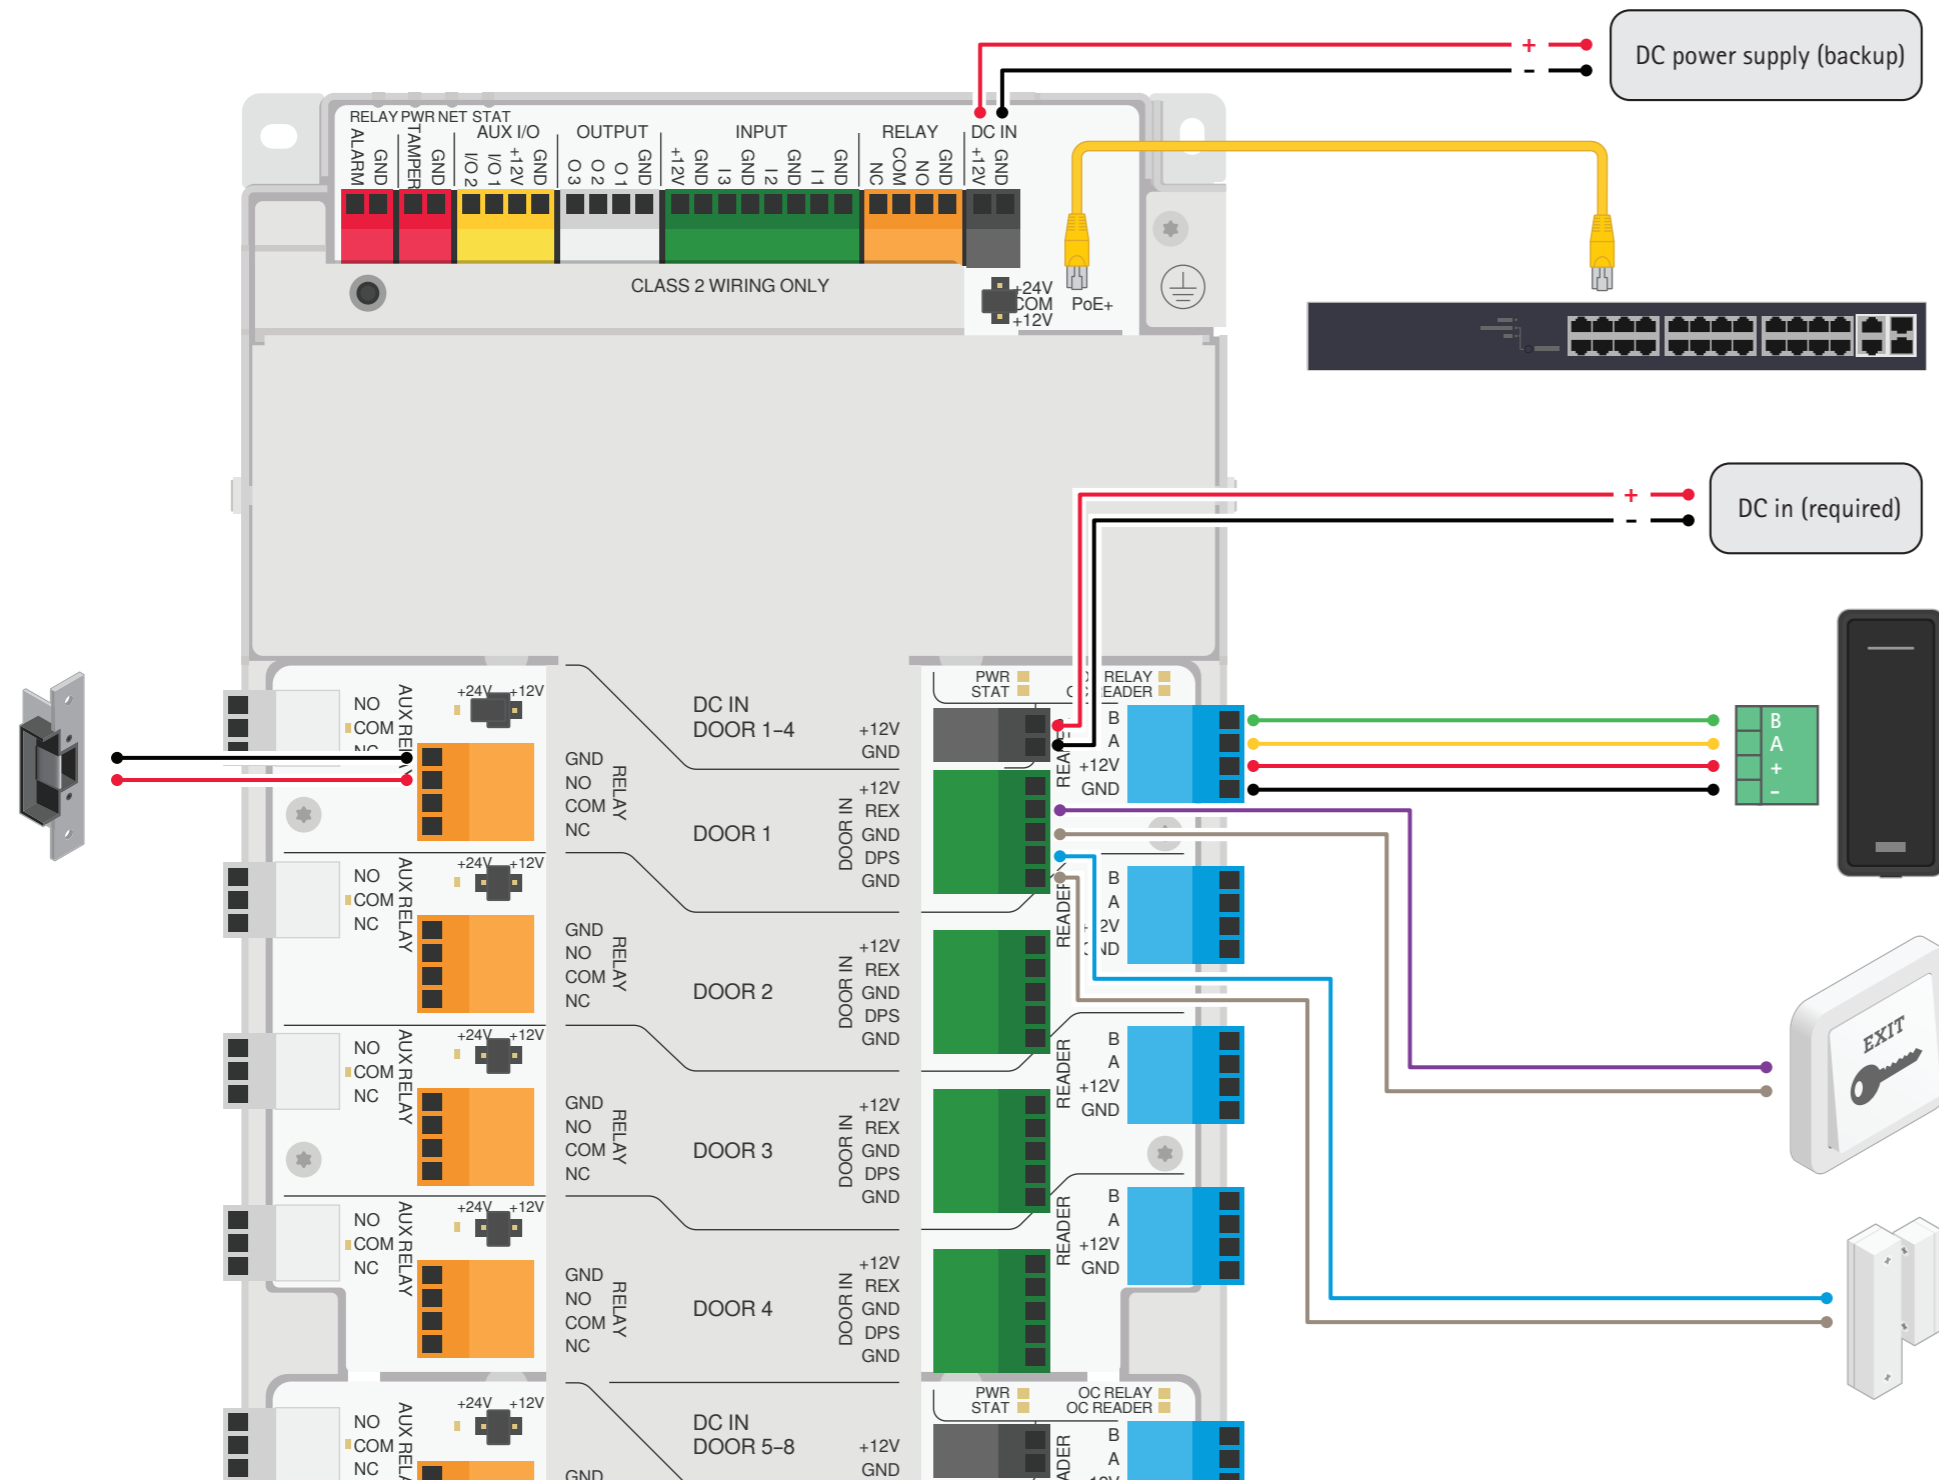

Adhere to local life safety code in all installations.
Illustration does not depict DC power backup and UPS.
Ensure that your power supplies and relays are rated for the intended purposes.
This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

OSDP reader – powered by the controller

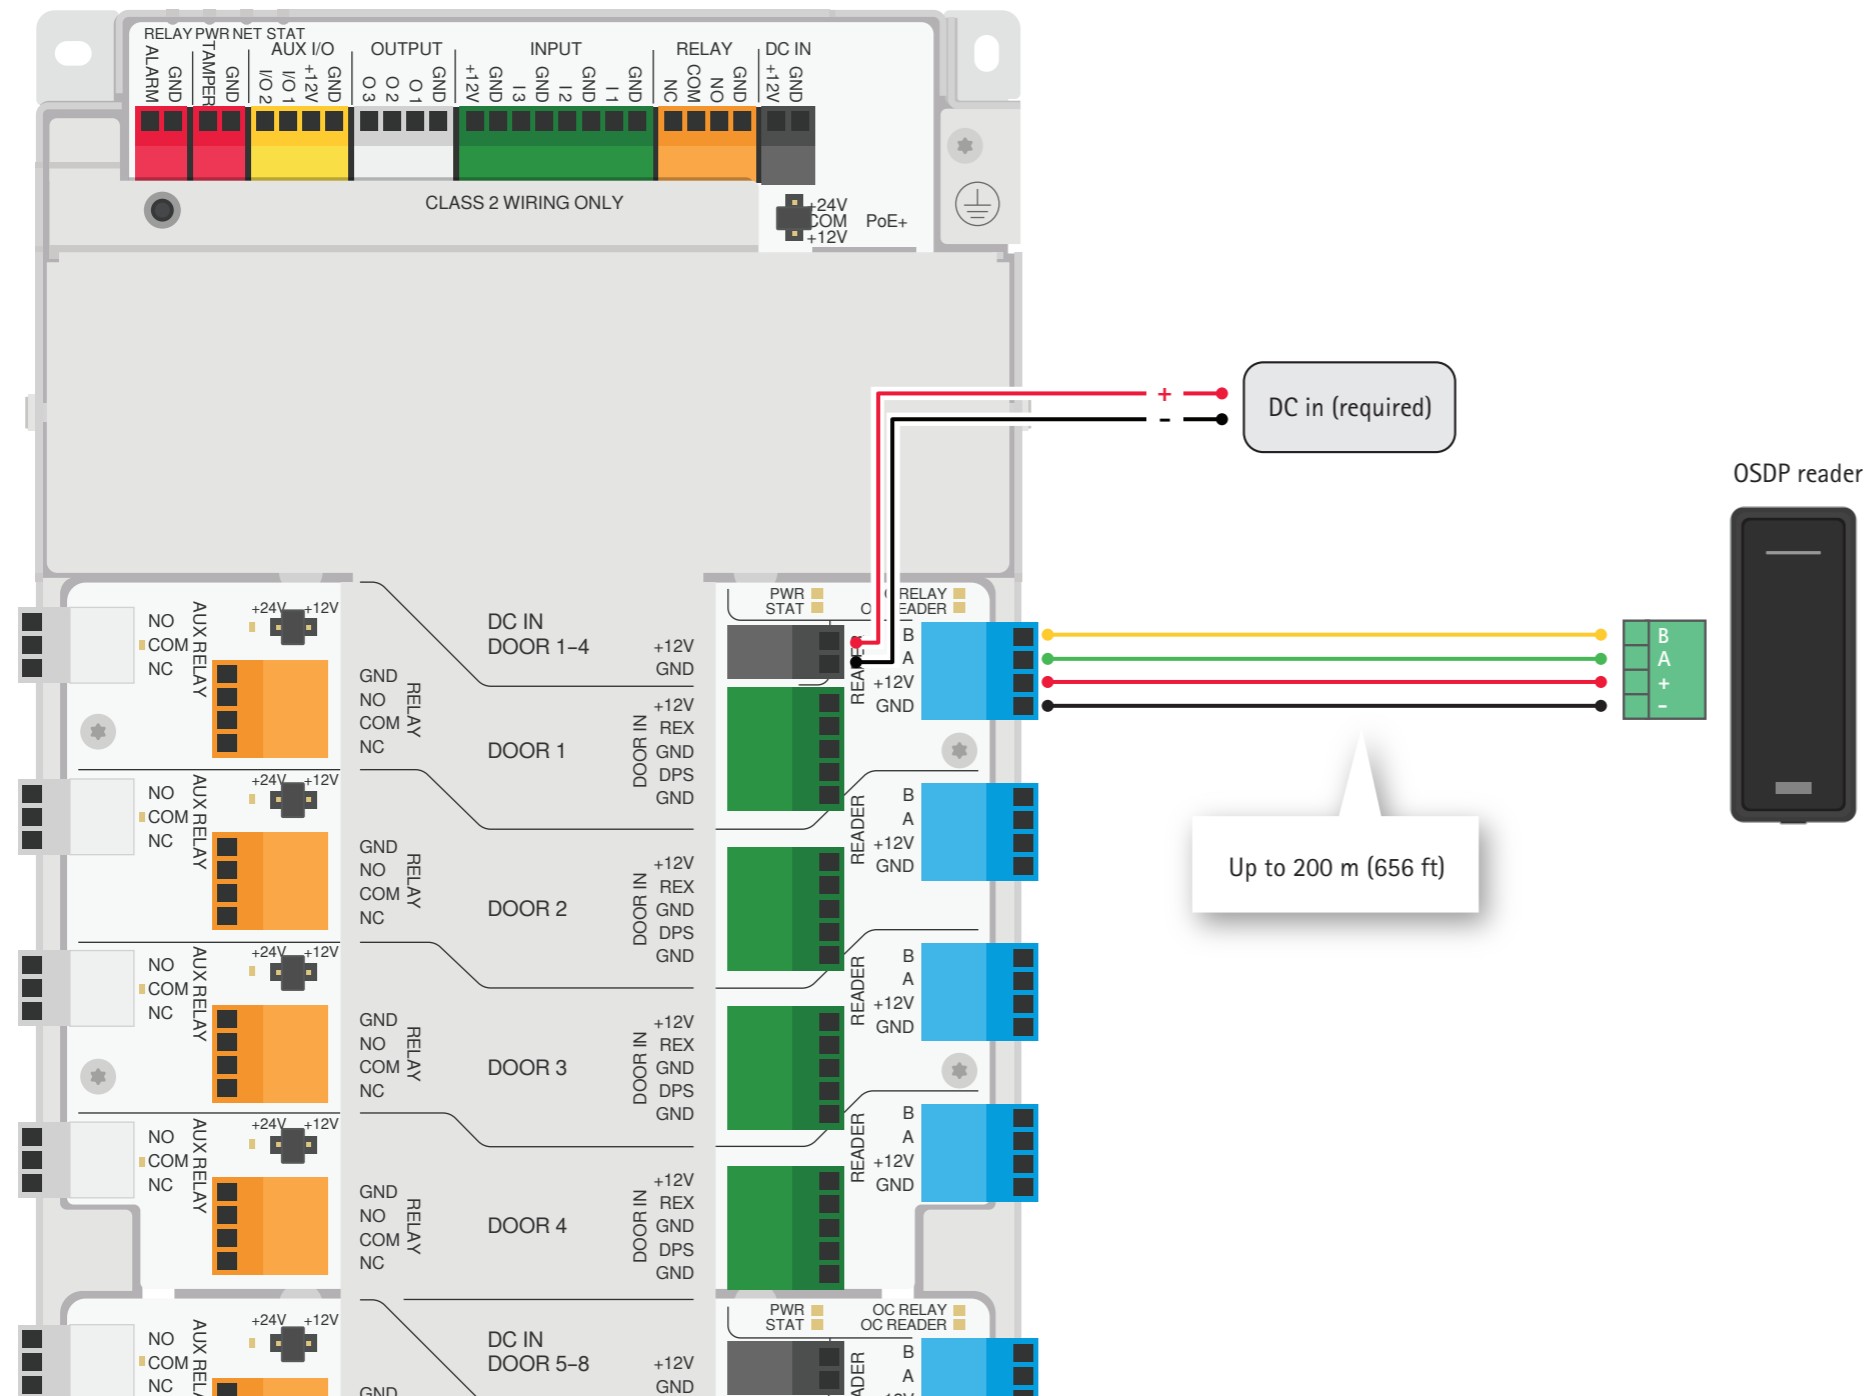

Application

One OSDP reader for the controller with configuration in AXIS Camera Station

Requirements


- > Reader wiring:
- > AWG 22-14

Considerations

- > DC power on door section required
- > All peripheral consumption within the controller's power budget

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select the relevant reader

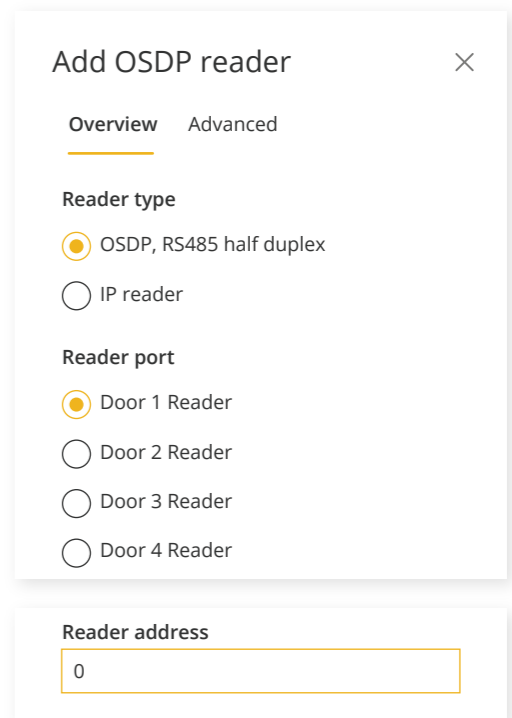


Adhere to local life safety code in all installations.

Illustration does not depict door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

OSDP reader – powered externally

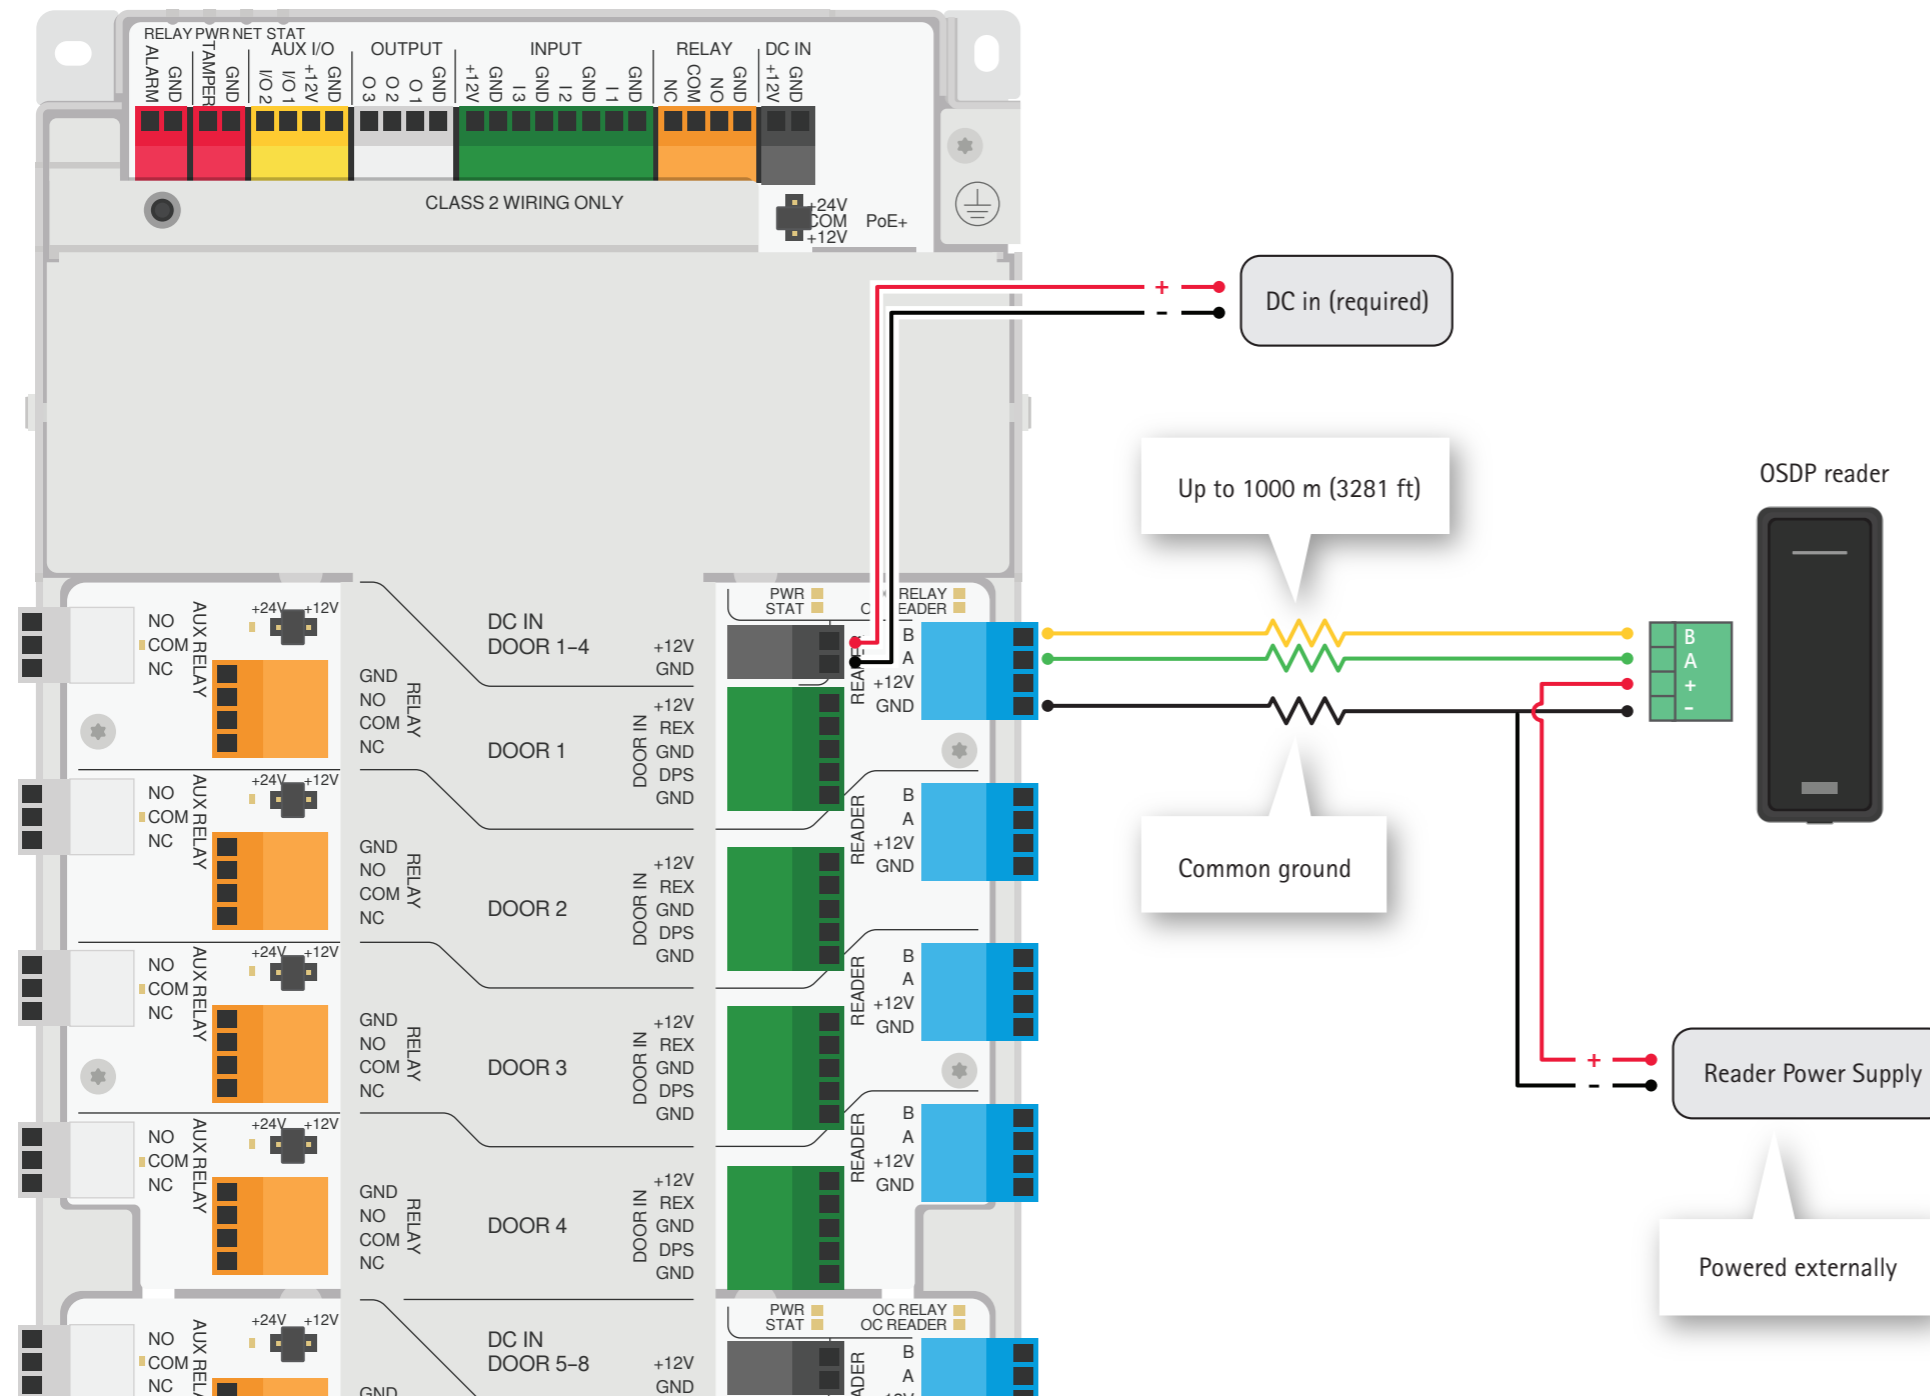

Application

One OSDP reader for the controller with configuration in AXIS Camera Station

Requirements


- > Reader powered externally, not by controller
- > Reader wiring: RS485
 - > Twisted pair
 - > AWG 26-14
 - > 120 ohm impedance

Considerations

- > DC power on door section required
- > All peripheral consumption within the controller's power budget

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select the relevant reader

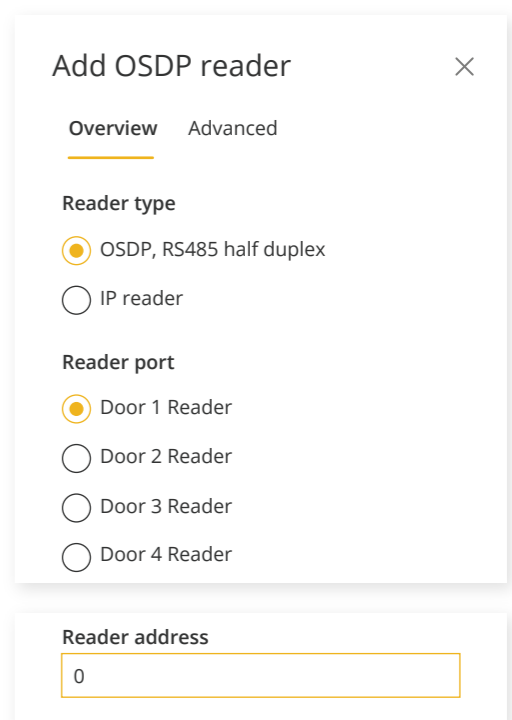


Adhere to local life safety code in all installations.

Illustration does not depict door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

OSDP reader – multi-drop

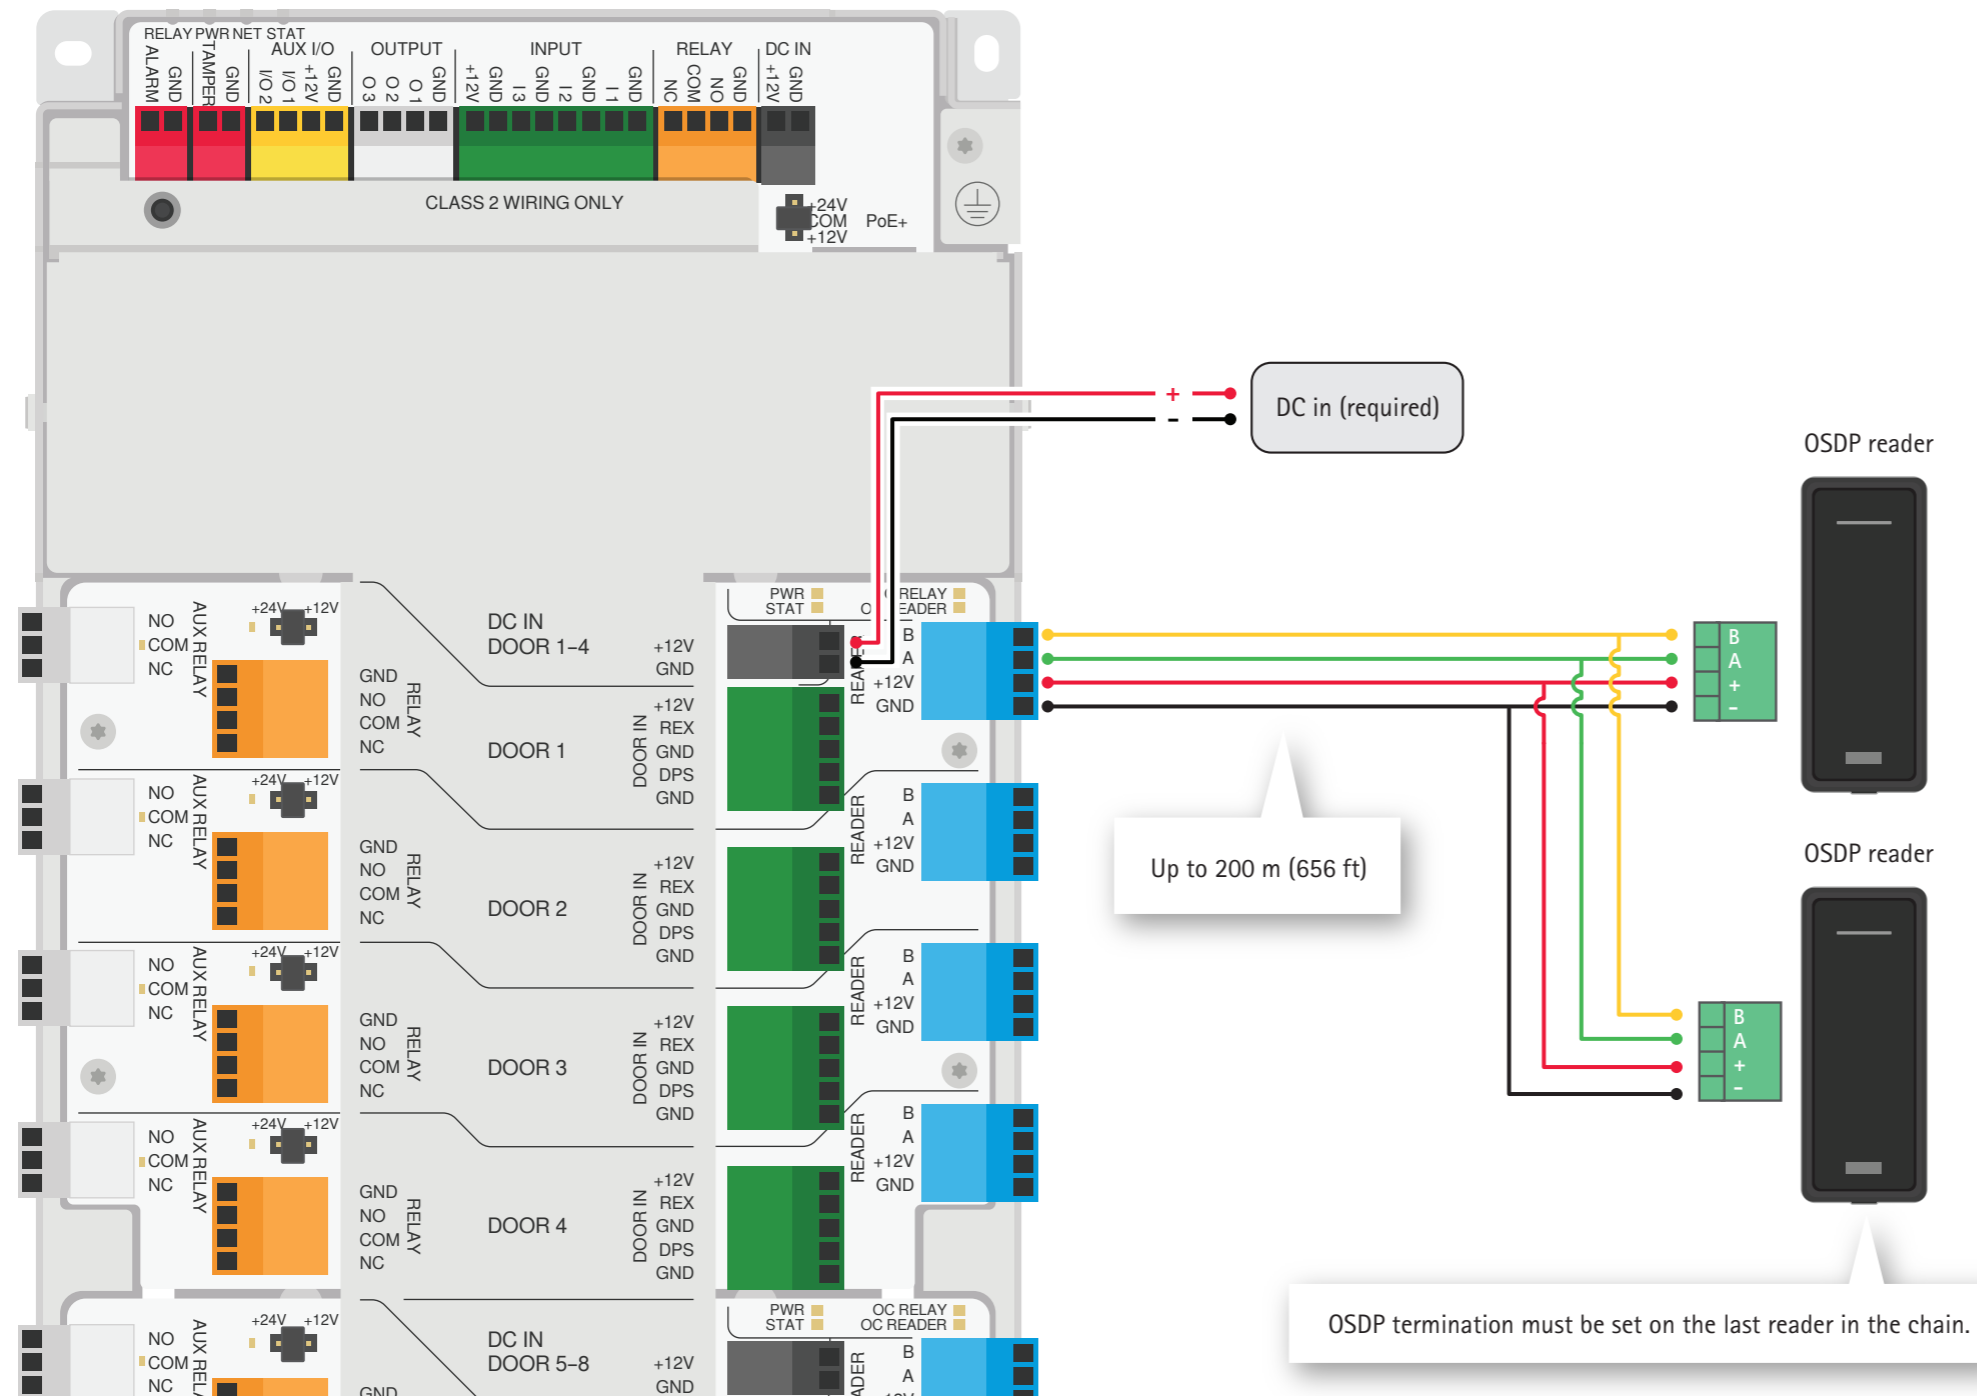

Application

Two OSDP readers (multi-drop) for the controller with configuration in AXIS Camera Station

Requirements


- > Reader wiring:
 - > AWG 22-14

Considerations

- > DC power on door section required
- > All peripheral consumption within the controller's power budget

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select the relevant reader
4. Set the address on the DIP switch and add address in the Reader address field.

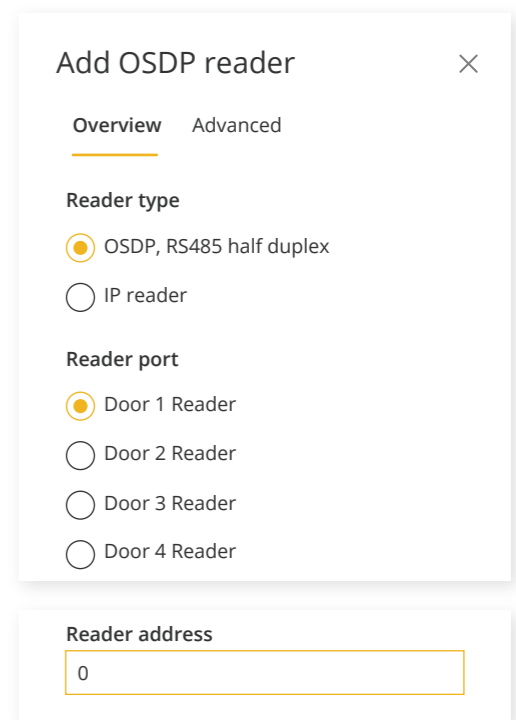


Adhere to local life safety code in all installations.

Illustration does not depict door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Wiegand reader – powered by the controller

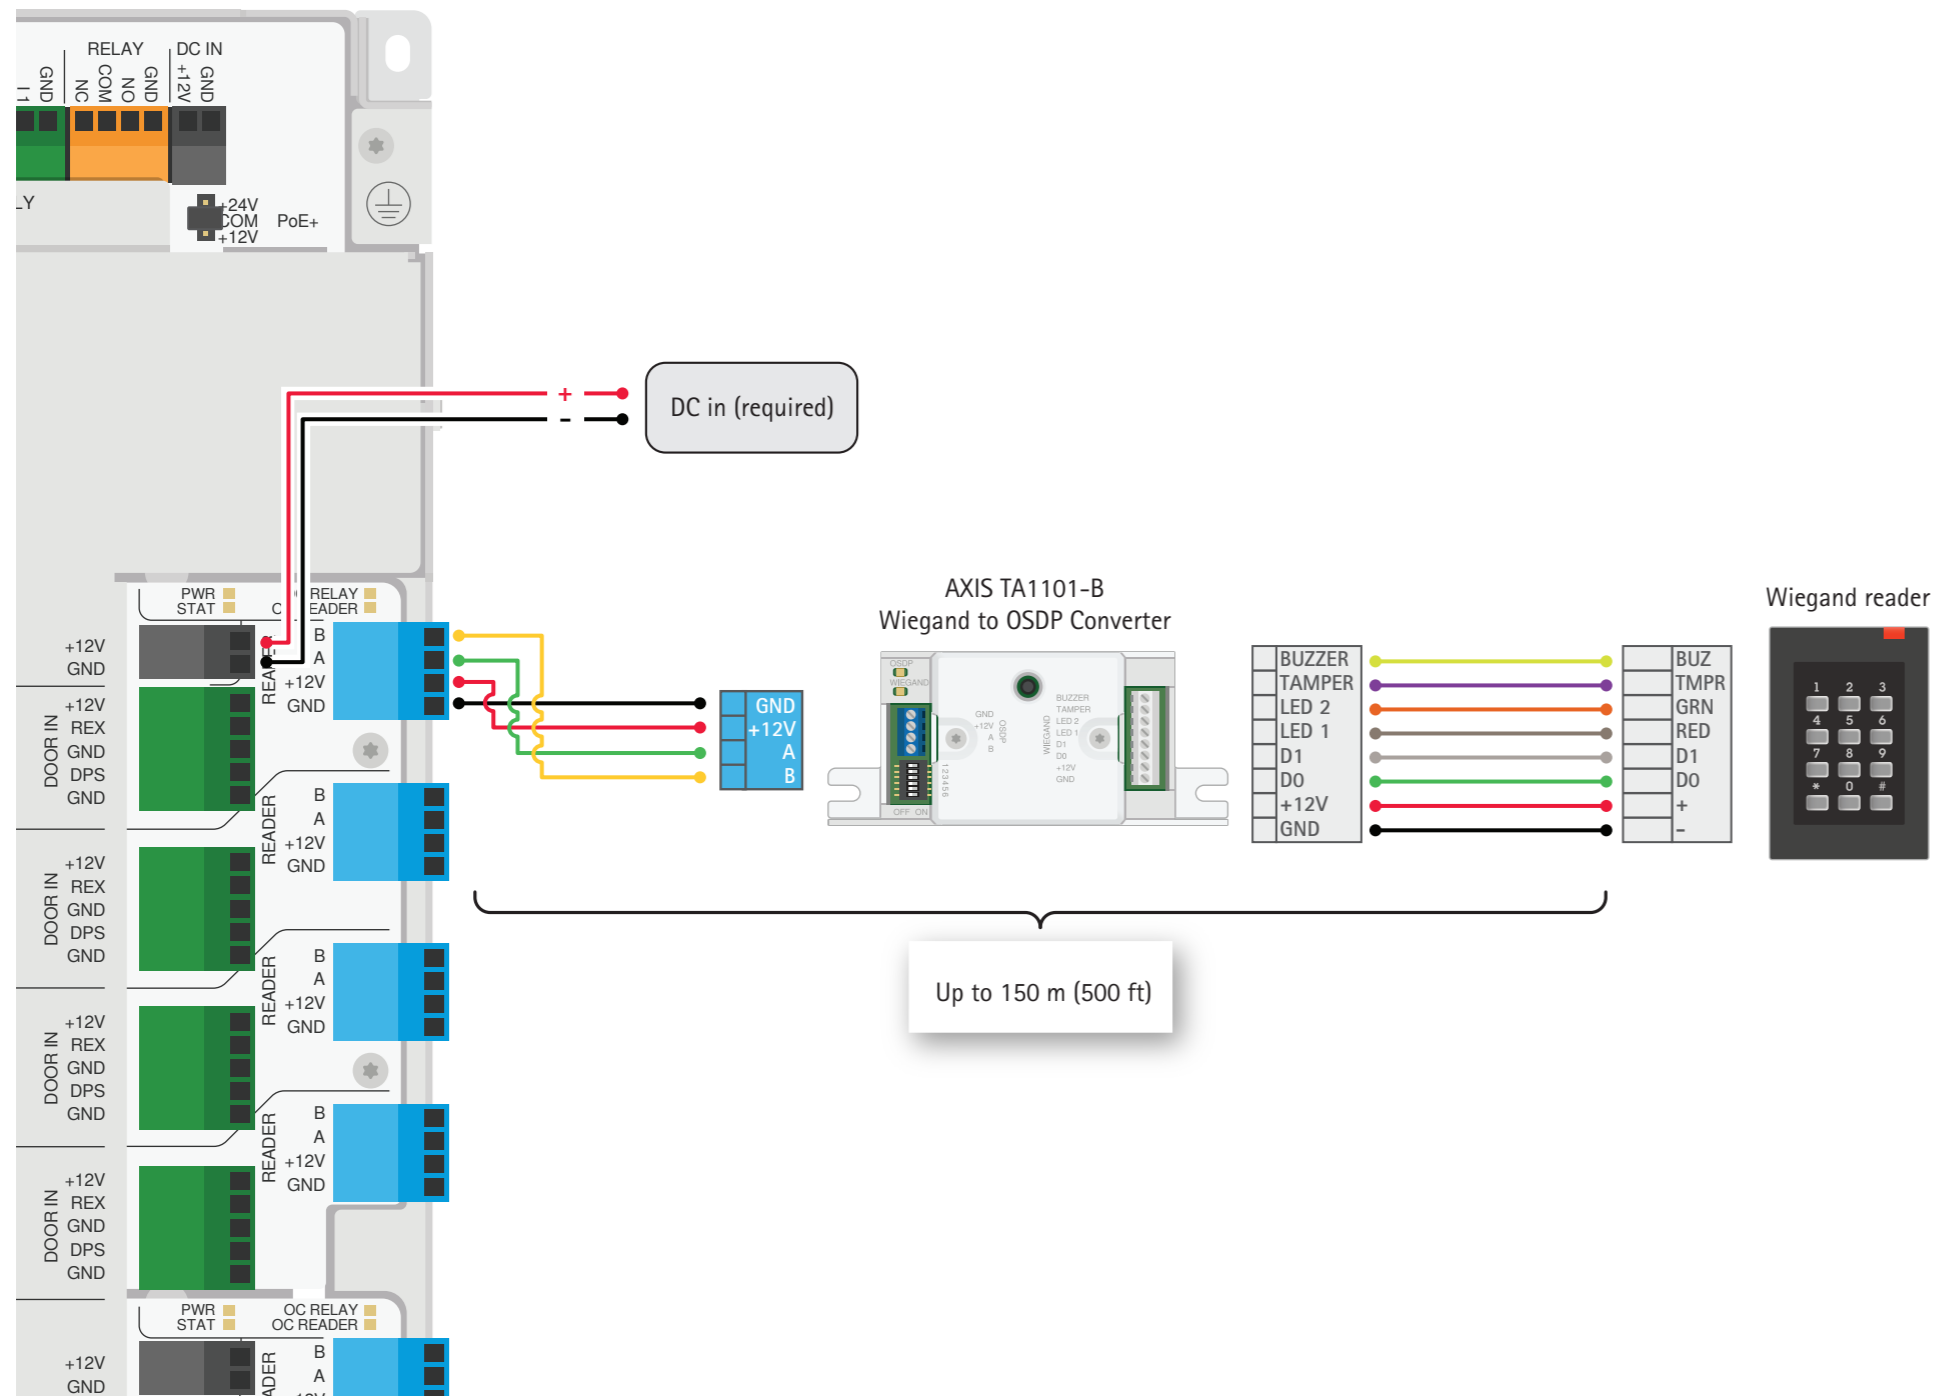

Application

One Wiegand reader for the controller with configuration in AXIS Camera Station

Requirements


- > AXIS TA1101-B unit required
- > AXIS TA1101-B wiring:
 - > AWG 22-16

Considerations

- > DC power on door section required
- > All peripheral consumption within the controller's power budget

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select the relevant reader

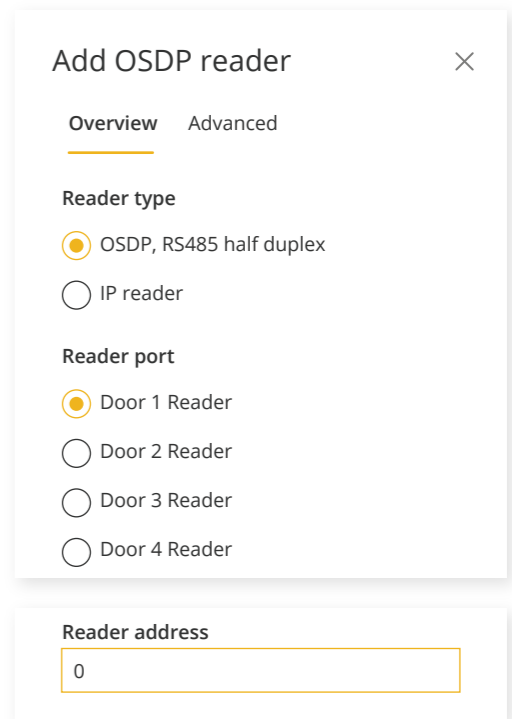


Adhere to local life safety code in all installations.

Illustration does not depict door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Wiegand reader – powered externally

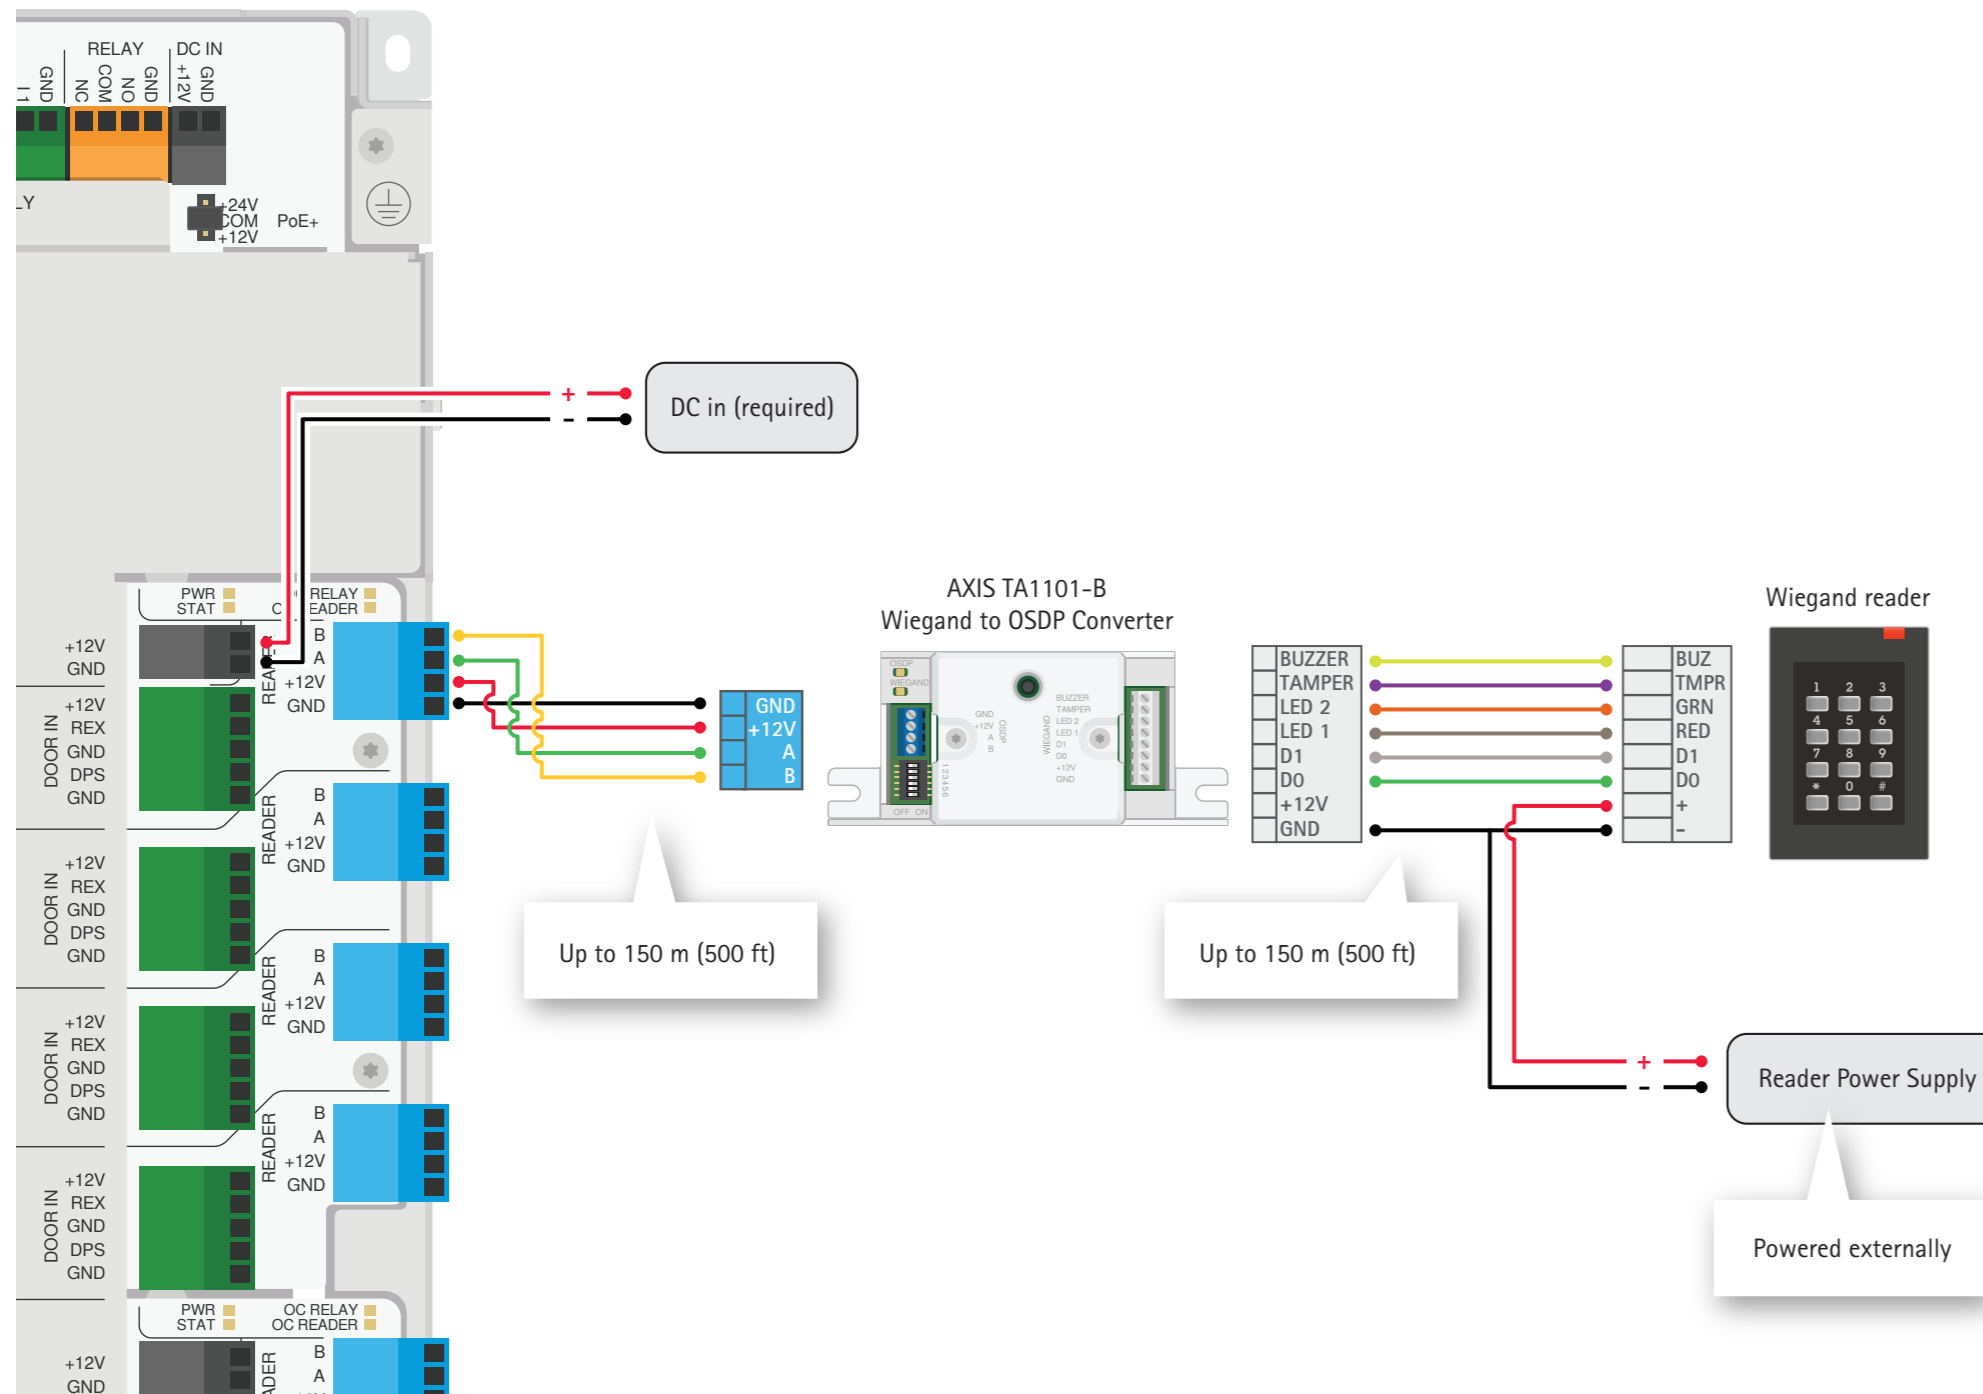

Application

One Wiegand reader for the controller with configuration in AXIS Camera Station

Requirements


- > Reader powered externally, not by controller
- > AXIS TA1101-B unit required
- > AXIS TA1101-B wiring:
 - > AWG 22-16

Considerations

- > DC power on door section required
- > All peripheral consumption within the controller's power budget

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select the relevant reader

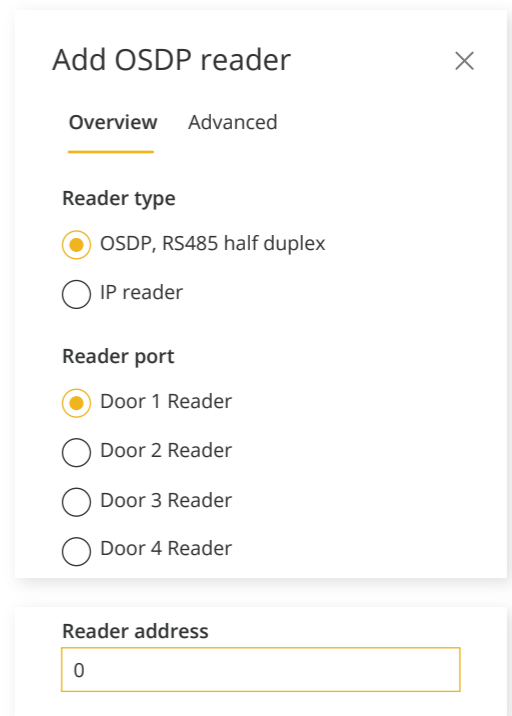


Adhere to local life safety code in all installations.

Illustration does not depict door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Wiegand reader – powered externally, long cable

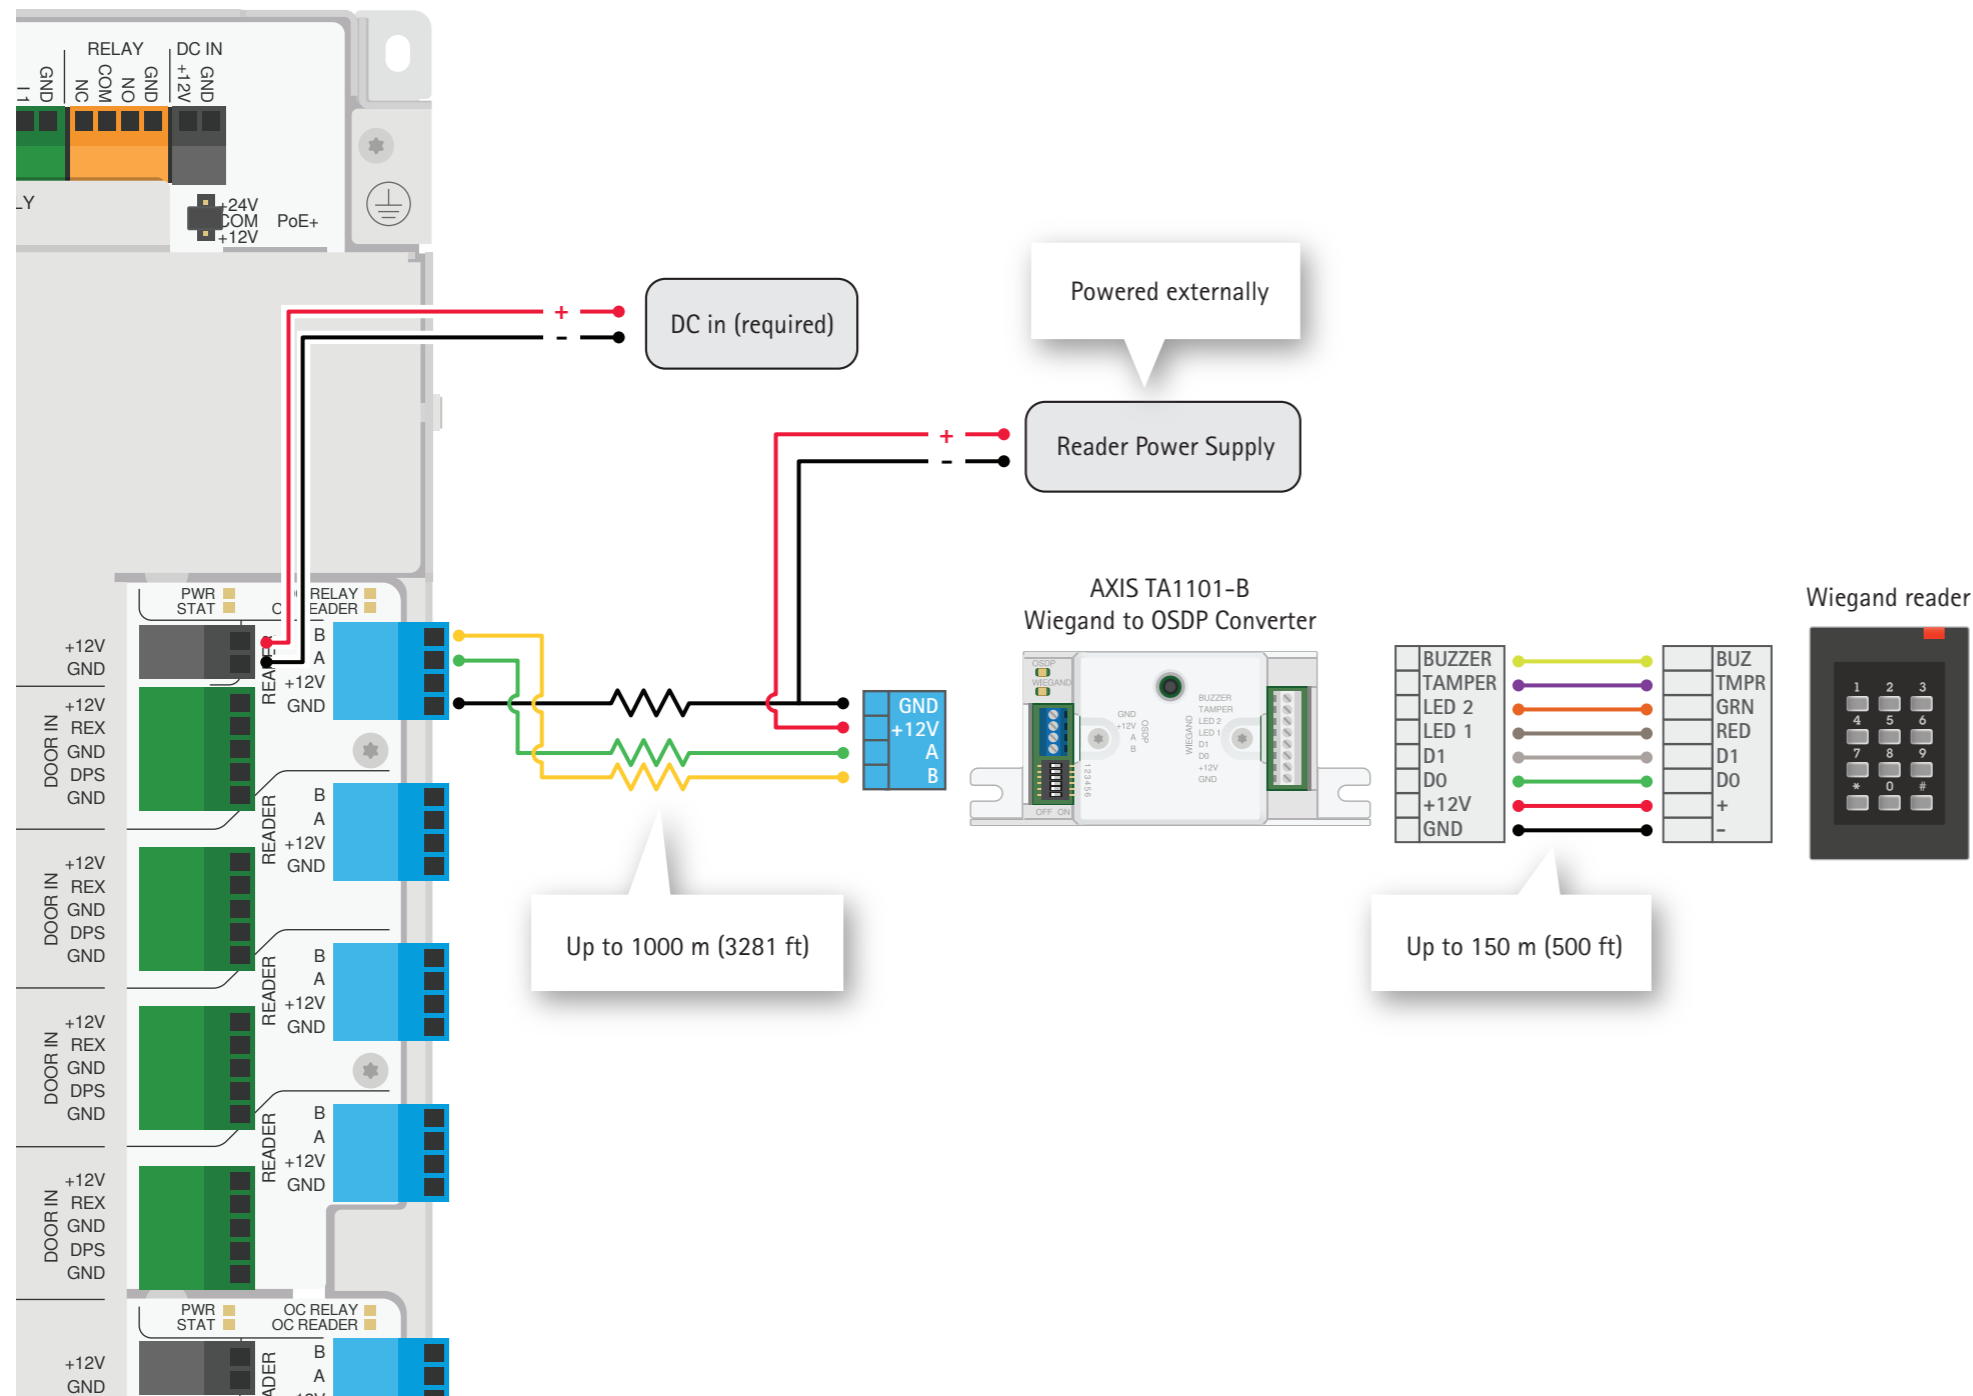

Application

One Wiegand reader for the controller with configuration in AXIS Camera Station

Requirements


- > Reader powered externally, not by controller
- > AXIS TA1101-B unit required
- > AXIS TA1101-B wiring:
 - > AWG 22-16

Considerations

- > DC power on door section required
- > All peripheral consumption within the controller's power budget
- > We recommend connecting AXIS TA1101-B closer to the controller or closer to the reader

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select the relevant reader

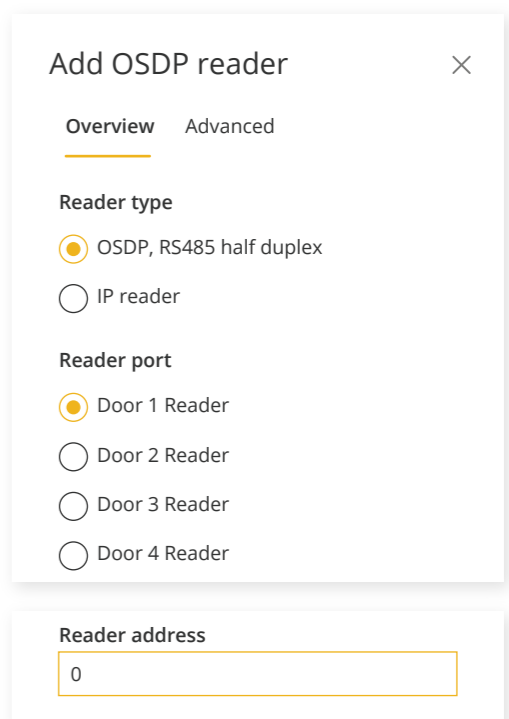


Adhere to local life safety code in all installations.

Illustration does not depict door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Wiegand reader – multi-drop

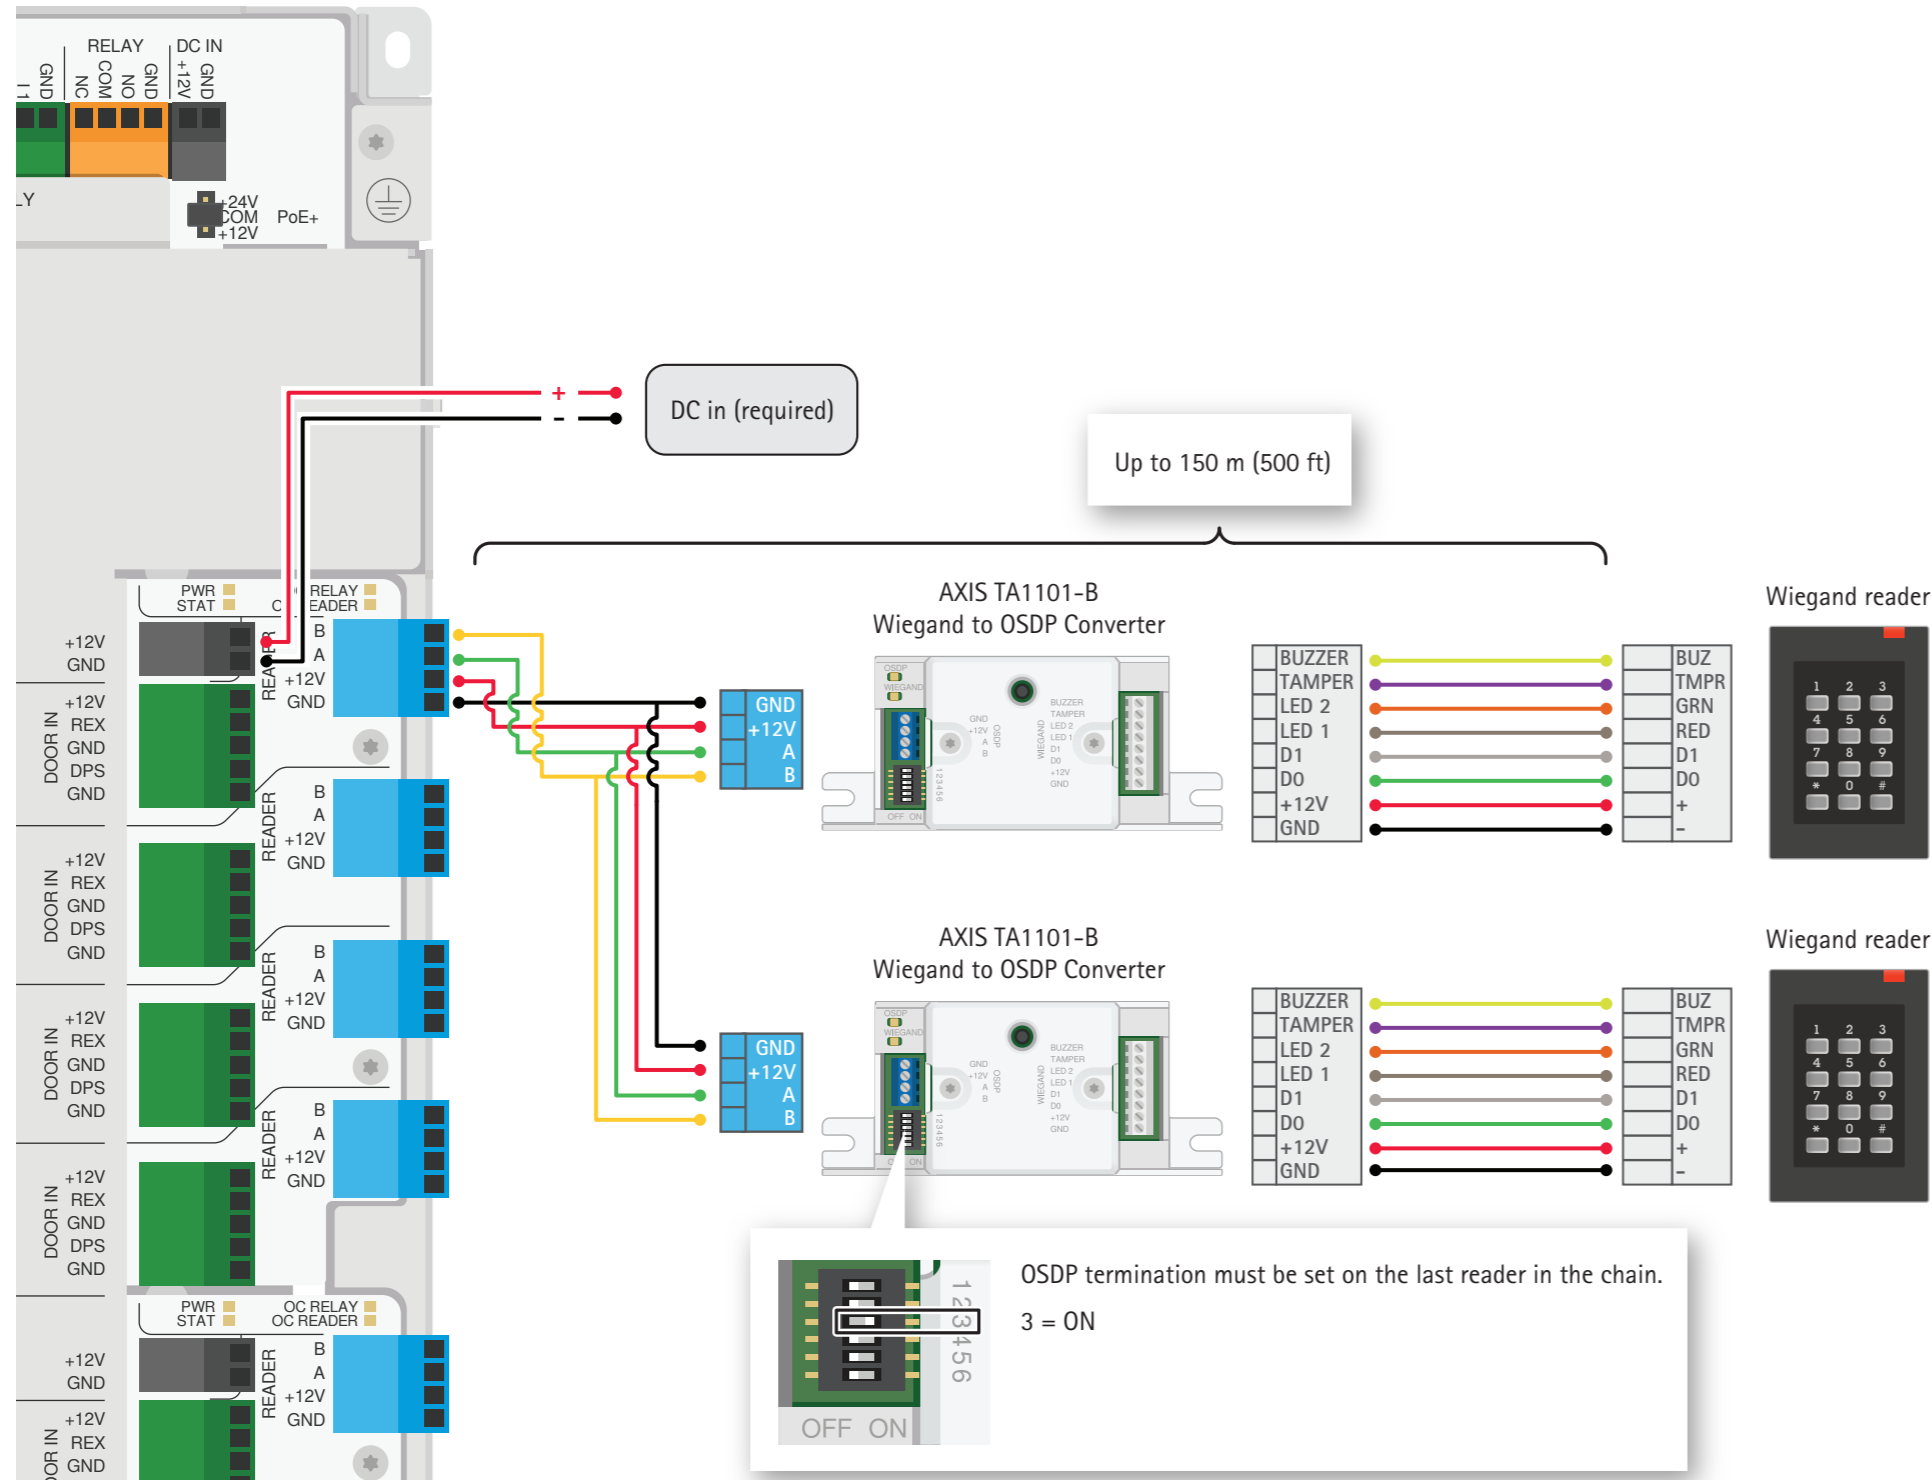

Application

Two Wiegand readers (multi-drop) for the controller with configuration in AXIS Camera Station

Requirements


- > AXIS TA1101-B unit required
- > AXIS TA1101-B wiring:
 - > AWG 22-16

Considerations

- > DC power on door section required
- > All peripheral consumption within the controller's power budget

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select the relevant reader
4. Set the address on the DIP switch and add address in the Reader address field.

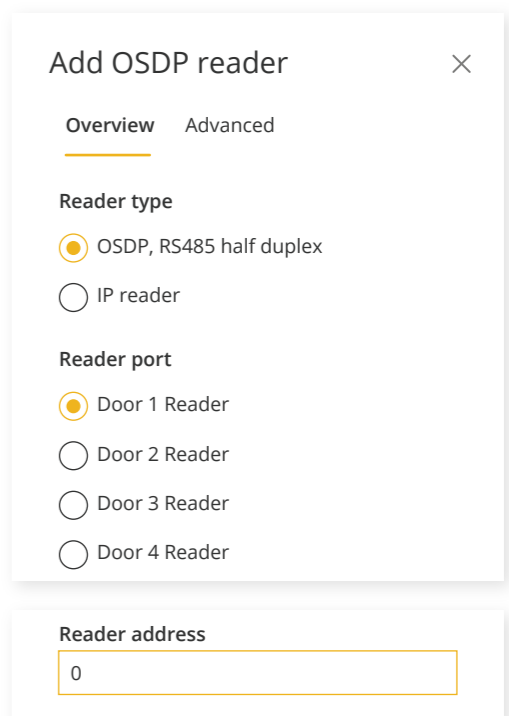

Adhere to local life safety code in all installations.

Illustration does not depict door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Wiegand and OSDP reader – multi-drop

Application

Two readers (multi-drop) for the controller with configuration in AXIS Camera Station

Requirements


- > AXIS TA1101-B unit required
- > AXIS TA1101-B wiring:
 - > AWG 22-16
- > OSDP reader wiring:
 - > AWG 22-14

Considerations

- > DC power on door section required
- > All peripheral consumption within the controller's power budget

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select the relevant reader
4. Set the address on the DIP switch and add address in the Reader address field.

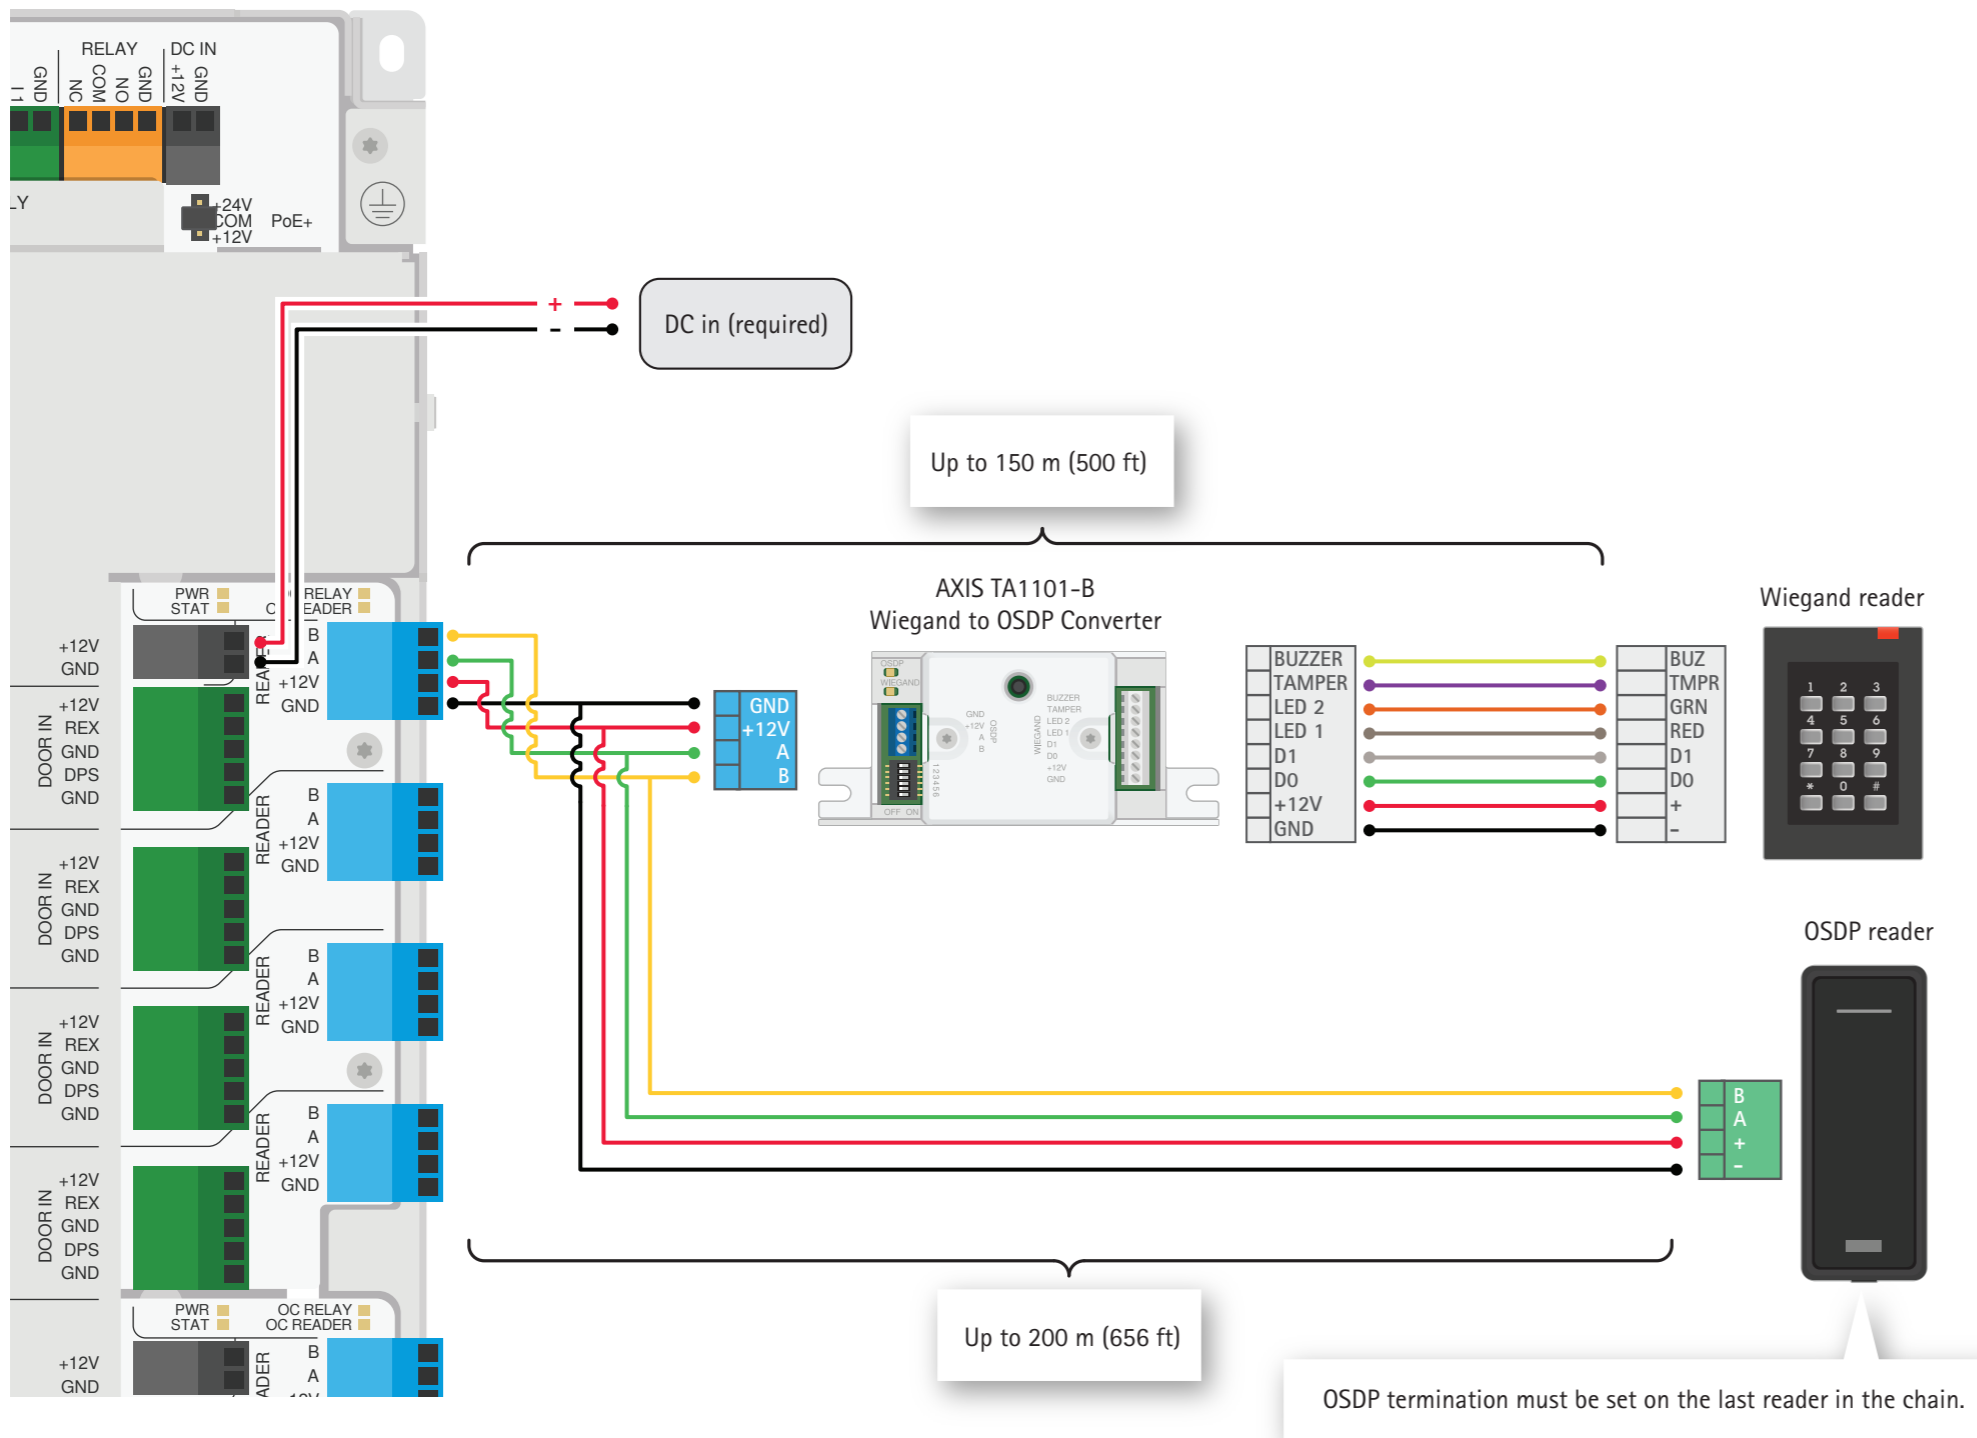

Add OSDP reader

Overview Advanced

Reader type

OSDP, RS485 half duplex

IP reader

Reader port

Door 1 Reader

Door 2 Reader


Door 3 Reader

Door 4 Reader

Reader address

Adhere to local life safety code in all installations.
 Illustration does not depict door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.
 Ensure that your power supplies and relays are rated for the intended purposes.
 This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Installation for door inputs

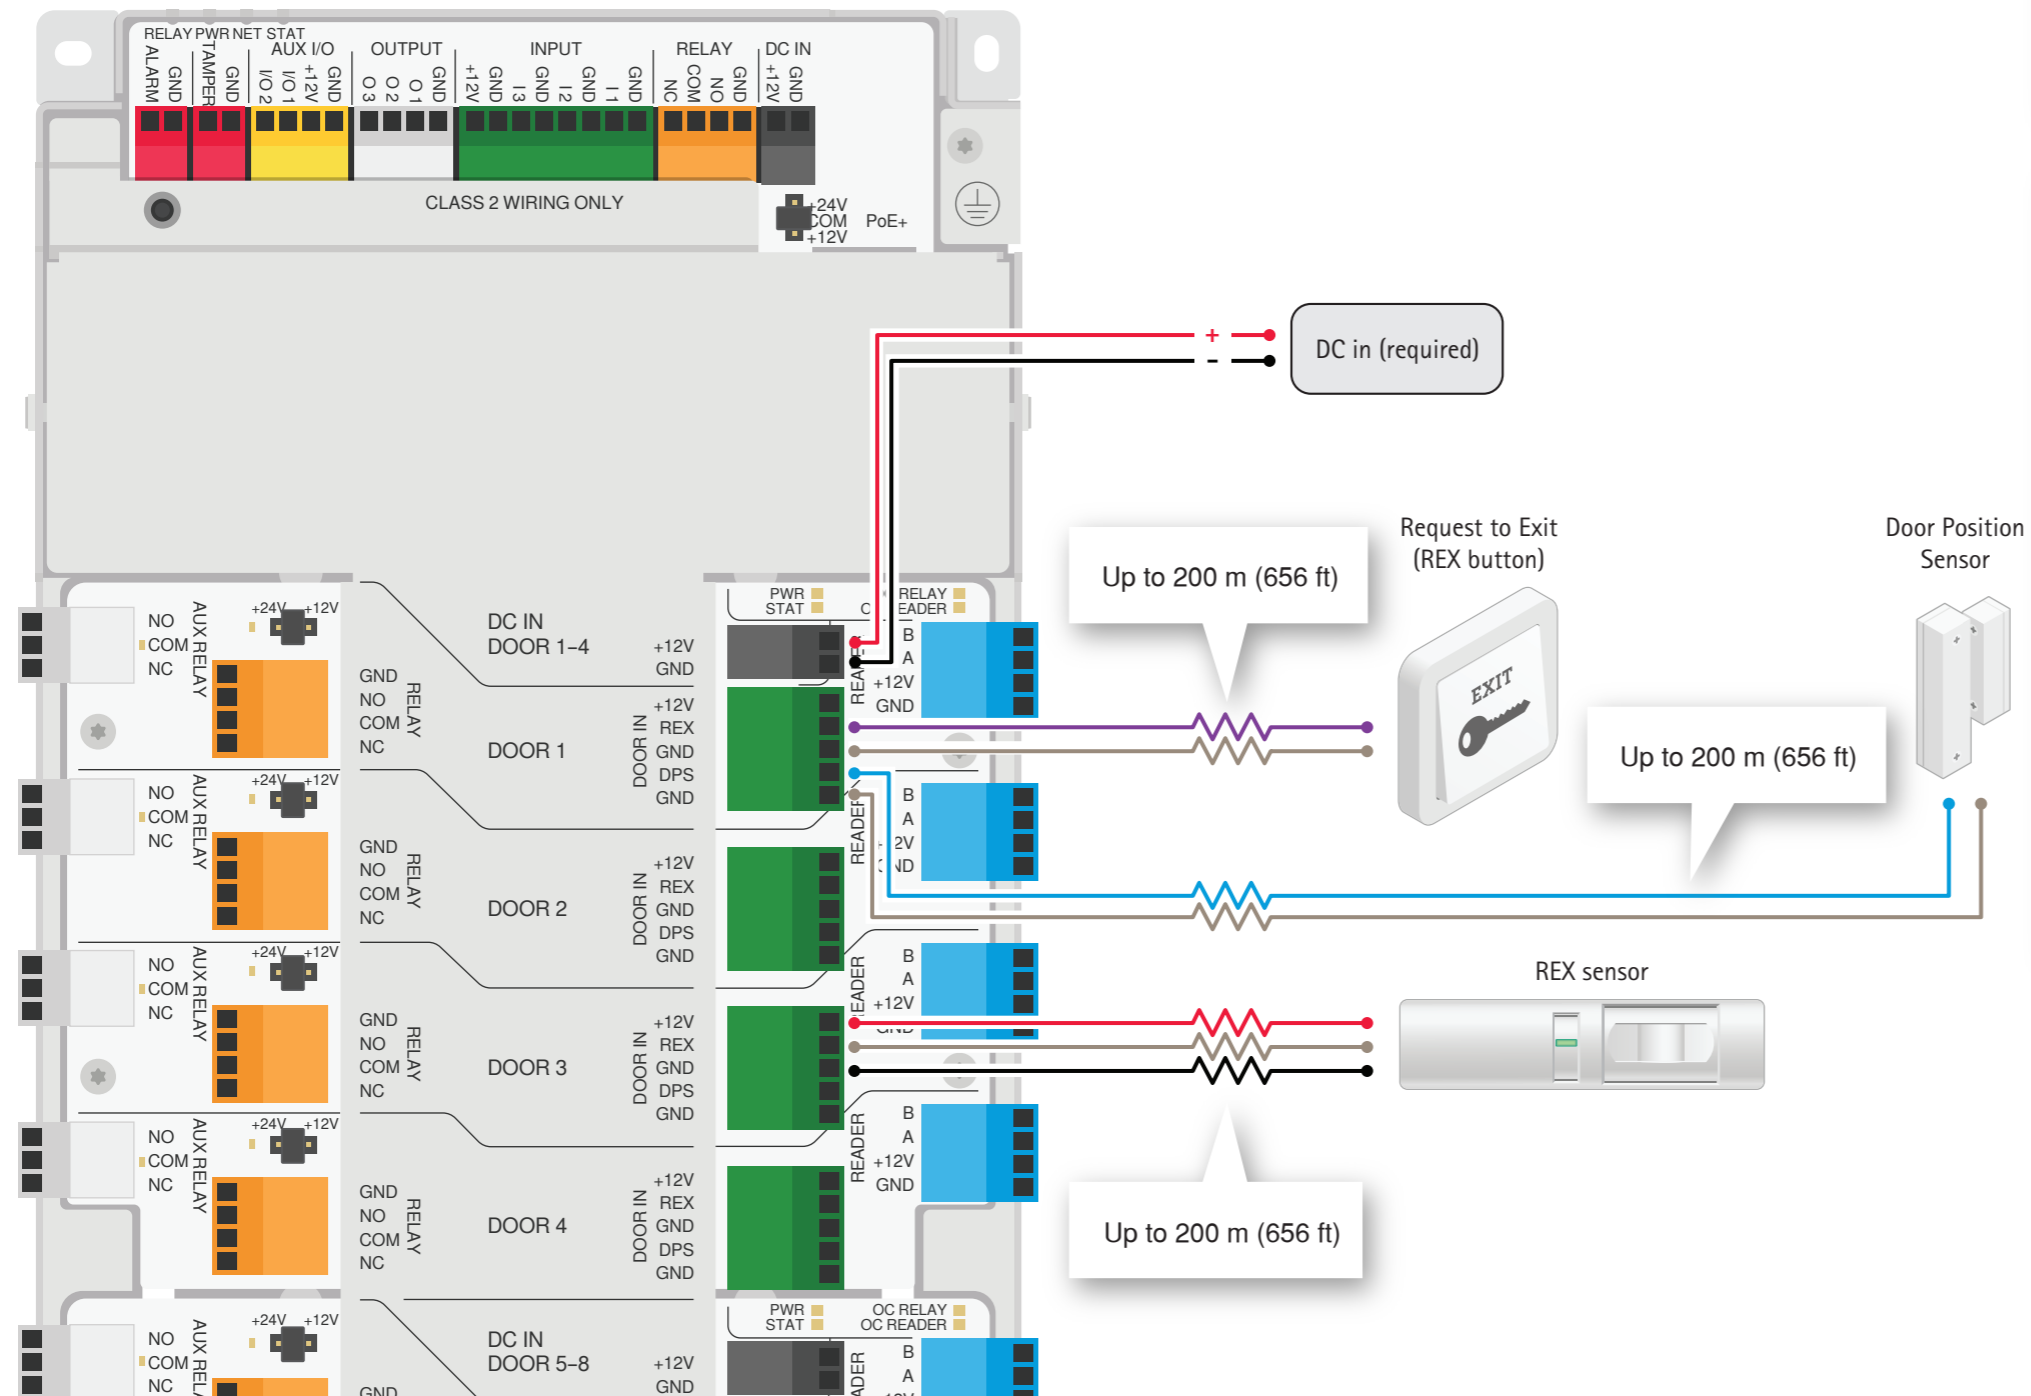

Requirements

- > Wiring:
 - > AWG 24-14

Considerations

- > REX sensor:
 - > Door 1-4 combined 400 mA at 12V DC
 - > Door 5-8 combined 400 mA at 12V DC

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Add a door position sensor and assign it to DPS 1

Add door position sensor ✕

Connected to

Door 1 DPS

5. Add a REX device on door side B and assign it to REX 1

Add REX device ✕

Connected to

Door 1 REX



Adhere to local life safety code in all installations.

Illustration does not depict readers, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

Door relay

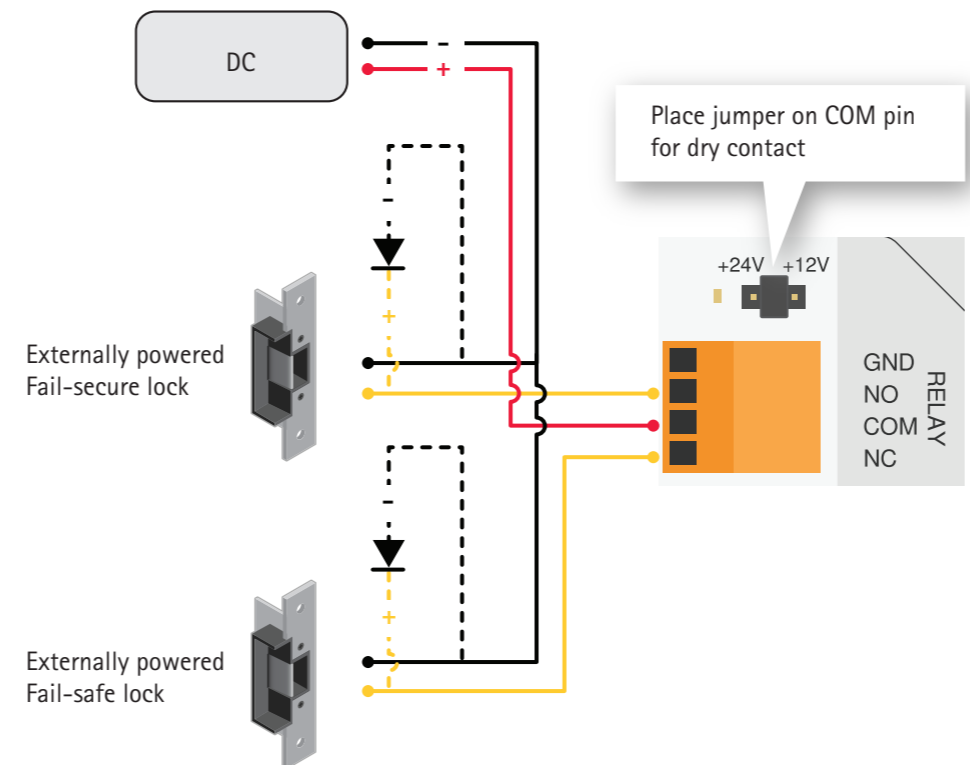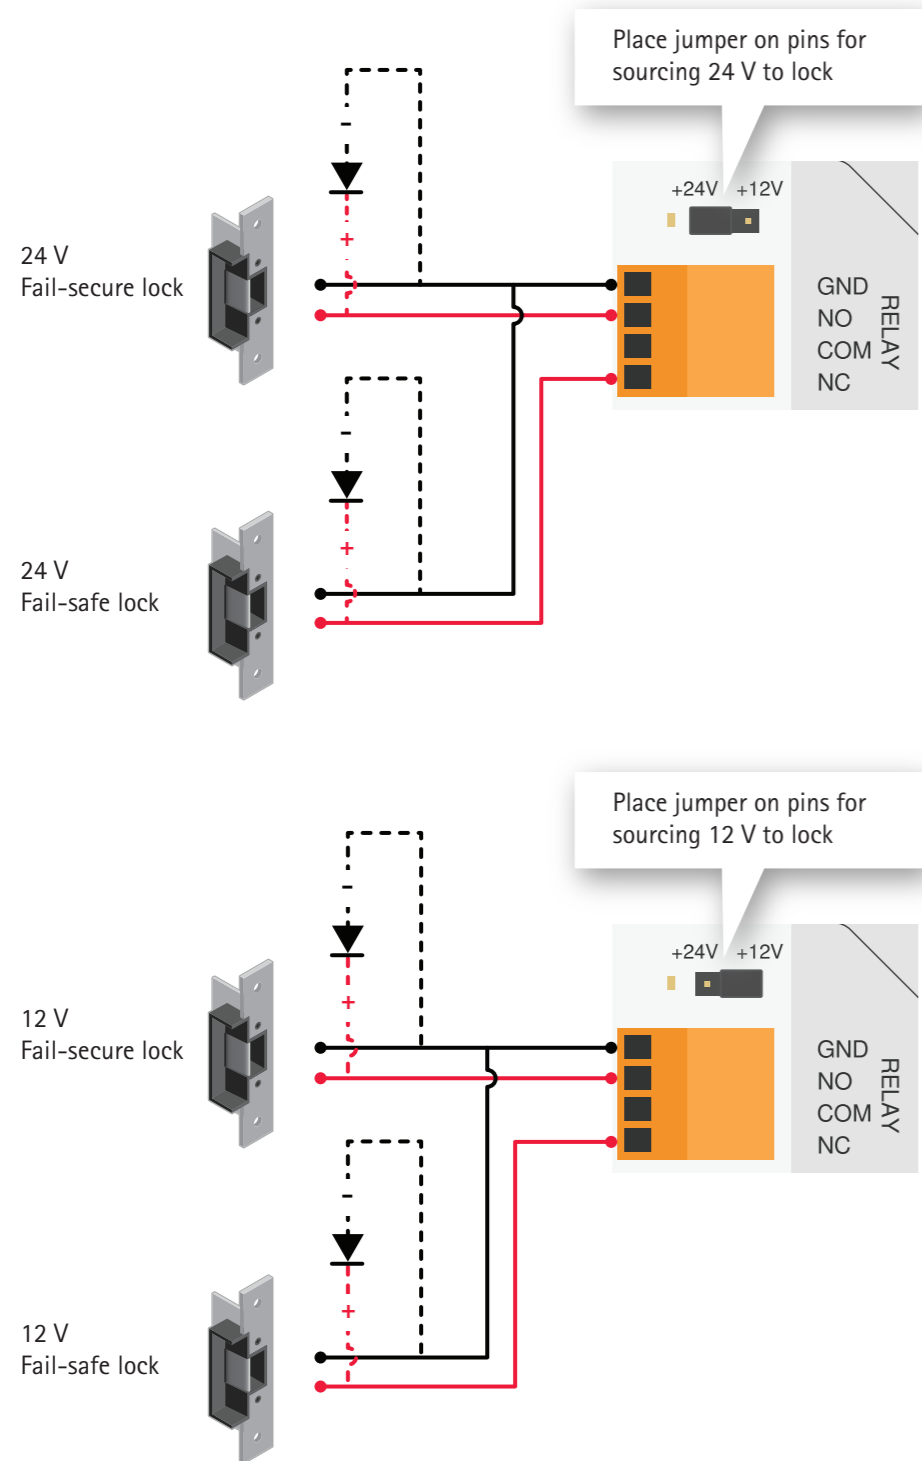

Application

For product-specific voltage and specification for the relay, see the product datasheet.

Requirements

- > Door relay 1-4:
 - > 3.8 A combined at 12 V DC
 - > 1.5 A combined at 24 V DC
- > Door relay 5-8:
 - > 3.8 A combined at 12 V DC
 - > 1.5 A combined at 24 V DC
- > Dry:
 - > 4 A at 30 V DC
- > Wiring:
 - > AWG 16-14

Considerations

- > 12 V or 24 V fail-secure or fail-safe lock
- > If the lock is non-polarized, we recommend you to add an external flyback diode.

AXIS Camera Station configuration


1. Add a door
2. Connect to a door controller
3. Select Relay 1 for the first lock

Primary lock

Door 1 Relay
 ▼

Adhere to local life safety code in all installations.
 Illustration does not depict readers, door inputs, REX devices, controller power supply, network switch, DC power backup and UPS.
 Ensure that your power supplies and relays are rated for the intended purposes.
 This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

AUX relay

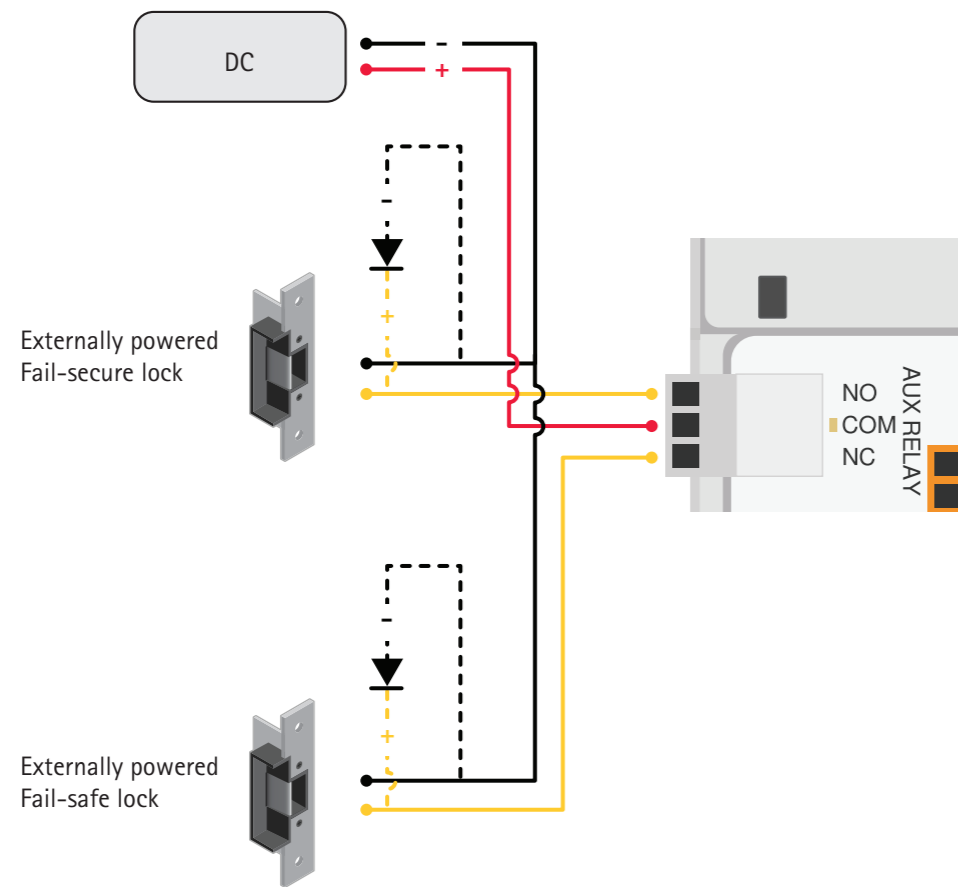

Application

For product-specific voltage and specification for the relay, see the product datasheet.

Requirements

- > AUX relay:
 - > 2A at 30V DC
- > Wiring:
 - > AWG 16-14

Considerations

- > Externally powered fail-secure or fail-safe lock
- > If the lock is non-polarized, we recommend you to add an external flyback diode.

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Select AUX Relay 1 for the primary or secondary lock

Secondary lock

Door 1 AUX Relay


Adhere to local life safety code in all installations.

Illustration does not depict readers, door inputs, REX devices, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.

External tamper and emergency input connections

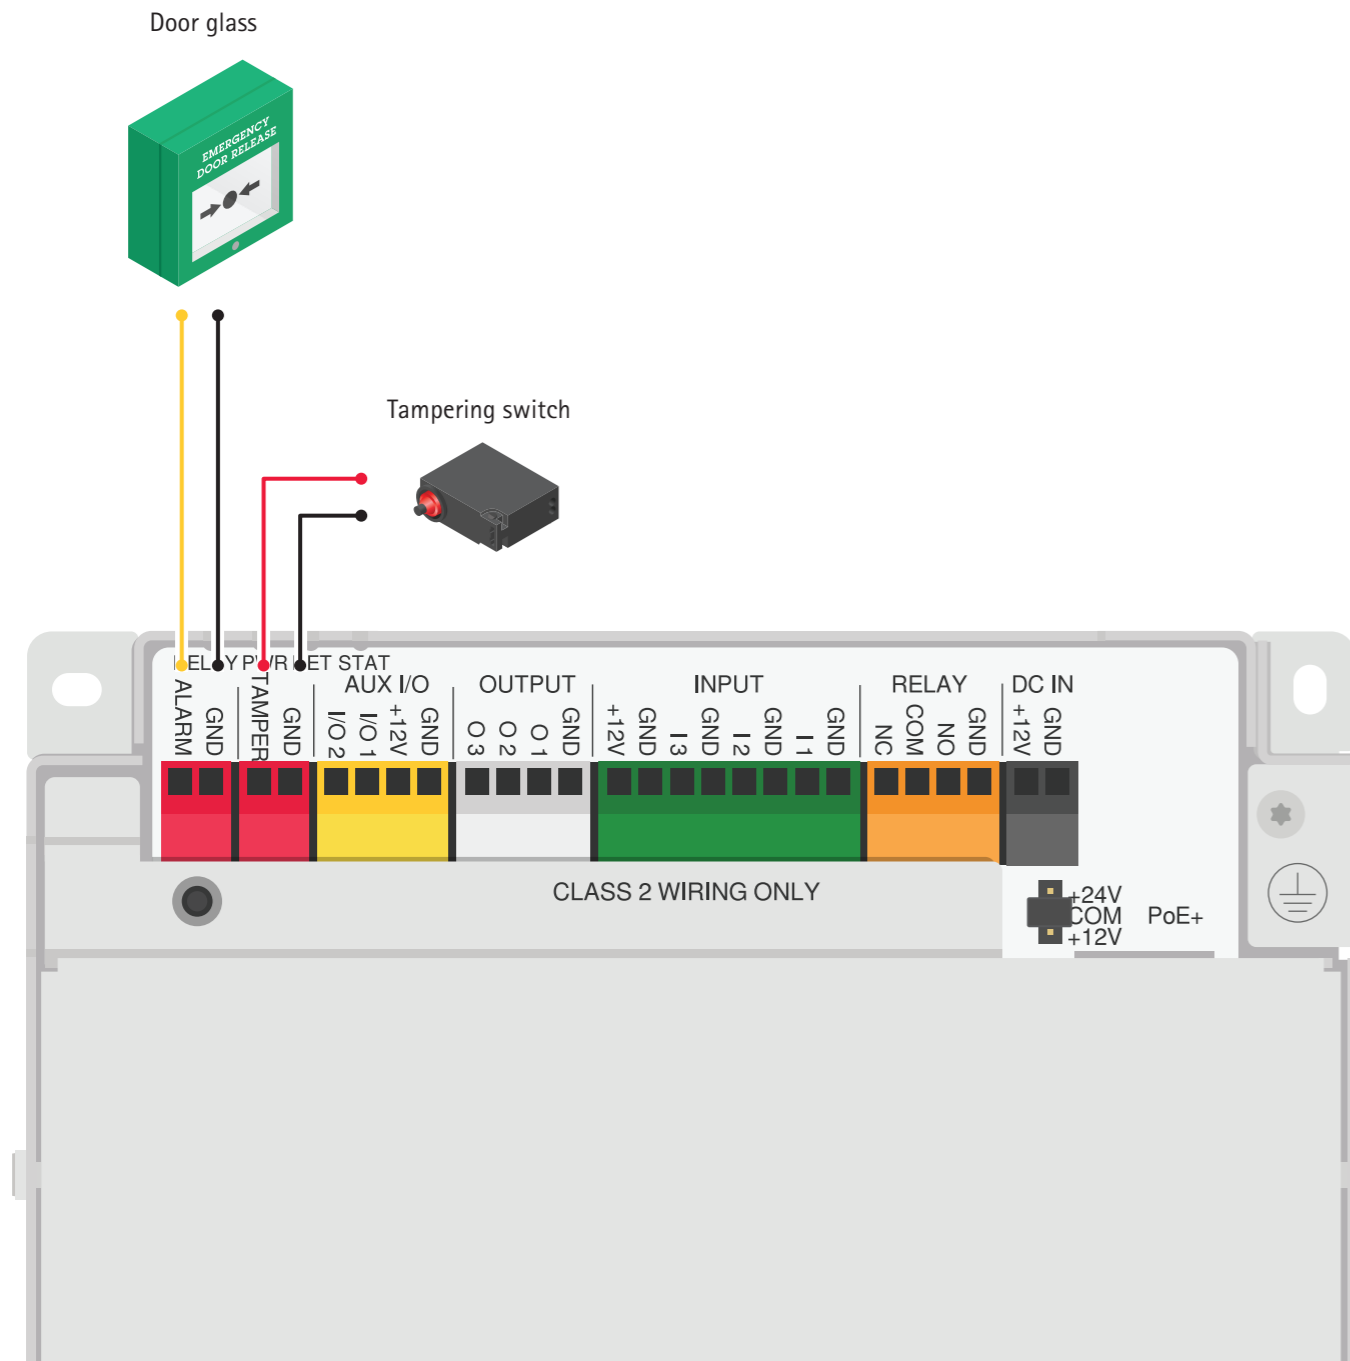

AXIS Camera Station configuration

1. Add a door
2. Connect to a door controller
3. Add Emergency input and choose configuration

Add Emergency input ✕

Emergency state

Circuit is open

Circuit is closed

Debounce time (ms)

Emergency action

Unlock door

Lock door

Adhere to local life safety code in all installations.

Illustration does not depict readers, door inputs, REX devices, locks, controller power supply, network switch, DC power backup and UPS.

Ensure that your power supplies and relays are rated for the intended purposes.

This is just an example. Always refer to the pin chart provided from AXIS Camera Station or 3rd party access control management system for installation.